



Operating Manual BACnet Router Wi-Fi Start-up Guide



Revision: 3.1

Document No.: T18621

Print Spec: 10000005389 (F)



fieldserver

MSA Safety
1000 Cranberry Woods Drive
Cranberry Township, PA 16066 USA

U.S. Support Information:
+1 408 964-4443
+1 800 727-4377
Email: smc-support@msasafety.com

EMEA Support Information:
+31 33 808 0590
Email: smc-support.emea@msasafety.com

For your local MSA contacts, please go to our website www.MSAsafety.com

Contents

1	BACnet Router Description	5
2	Equipment Setup	6
2.1	Mounting	6
2.2	Attaching the Antenna(s)	6
2.3	Physical Dimensions	7
3	Installation	8
3.1	Connecting the R1 & R2 Ports	8
3.1.1	Wiring	8
3.2	10/100 Ethernet Connection Port	9
4	Power up the Gateway	10
5	Connecting to the BACnet Router	11
5.1	Using the FieldServer Toolbox to Discover and Connect to the BACnet Router	11
5.2	Using a Web Browser	11
6	Setup Web Server Security	12
6.1	Login to the FieldServer	12
6.2	Select the Security Mode	14
6.2.1	HTTPS with Own Trusted TLS Certificate	15
6.2.2	HTTPS with Default Untrusted Self-Signed TLS Certificate or HTTP with Built-in Payload Encryption	15
7	Setup Network	16
7.1	Ethernet 1	17
7.1.1	Wi-Fi Client Settings	18
7.1.2	Wi-Fi Access Point Settings	19
7.1.3	Routing Settings	20
8	Configuring the BACnet Router	21
8.1	Navigate to the BACnet Router Settings	21
8.2	BACnet Router Settings	22
8.2.1	Button Functions	22
8.2.2	Multiple Connections	23
8.2.3	BACnet Device	23
8.2.4	BACnet/IP	24
8.2.5	BACnet MS/TP, BACnet Ethernet and BACnet Explorer	25
8.3	Router Diagnostics	26
9	BACnet Explorer	27
9.1	Discover the Device List	28
9.2	View Device Details and Explore Points/Parameters	29
9.2.1	Edit the Present Value Field	32
10	MSA Grid - FieldServer Manager Setup	34
10.1	Create a New FieldServer Manager Account	34
10.2	Login to the FieldServer Manager	41
11	Troubleshooting	43

11.1	Tooltips	43
11.2	Taking a FieldServer Diagnostic Capture	44
11.3	Factory Reset Instructions	45
11.4	Internet Browser Software Support	45
11.5	Wi-Fi Signal Strength	45
12	 Additional Information	46
12.1	Change Web Server Security Settings After Initial Setup	46
12.1.1	Change Security Mode	47
12.1.2	Edit the Certificate Loaded onto the FieldServer	48
12.2	Change User Management Settings	49
12.2.1	Create Users	50
12.2.2	Edit Users	51
12.2.3	Delete Users	52
12.2.4	Change FieldServer Password	53
12.3	Specifications	54
12.4	Warnings for FCC and IC	55
13	 Limited 2 Year Warranty	58

1 BACnet Router Description

The BACnet Router provides stand-alone routing between BACnet networks such as BACnet/IP, BACnet Ethernet, and BACnet MS/TP – thereby allowing the system integrator to mix BACnet network technologies within a single BACnet internetwork. There are three physical communication ports on the BAS Router. One is a 10/100 Mbps Ethernet port and the other two are RS-485 MS/TP ports. Configuration is accomplished via a web page.

The BACnet Router with Wi-Fi (FS-ROUTER-BACW) model has one RS-485 port, one Ethernet 10/100 port and supports Wi-Fi network connection. Additionally, the Router acts as a Wi-Fi access point for modern web based configuration and remote access from any mobile device without user restrictions.

The BACnet Router is cloud ready and connects with the Grid MSA Safety's FieldServer cloud platform.

NOTE: A cellular version of the BACnet Router is not available.

NOTE: For MSA Grid – FieldServer Manager information, refer to the [MSA Grid - FieldServer Manager Start-up Guide](#) online through the MSA website.

NOTE: The latest versions of instruction manuals, driver manuals, configuration manuals and support utilities are available online through the [MSA FieldServer webpage](#).

2 Equipment Setup

2.1 Mounting


The gateway can be mounted using the DIN rail mounting bracket on the back of the unit.



2.2 Attaching the Antenna(s)

Screw in the Wi-Fi antenna to the front of the unit as shown in [Section 2.3 Physical Dimensions](#).

2.3 Physical Dimensions

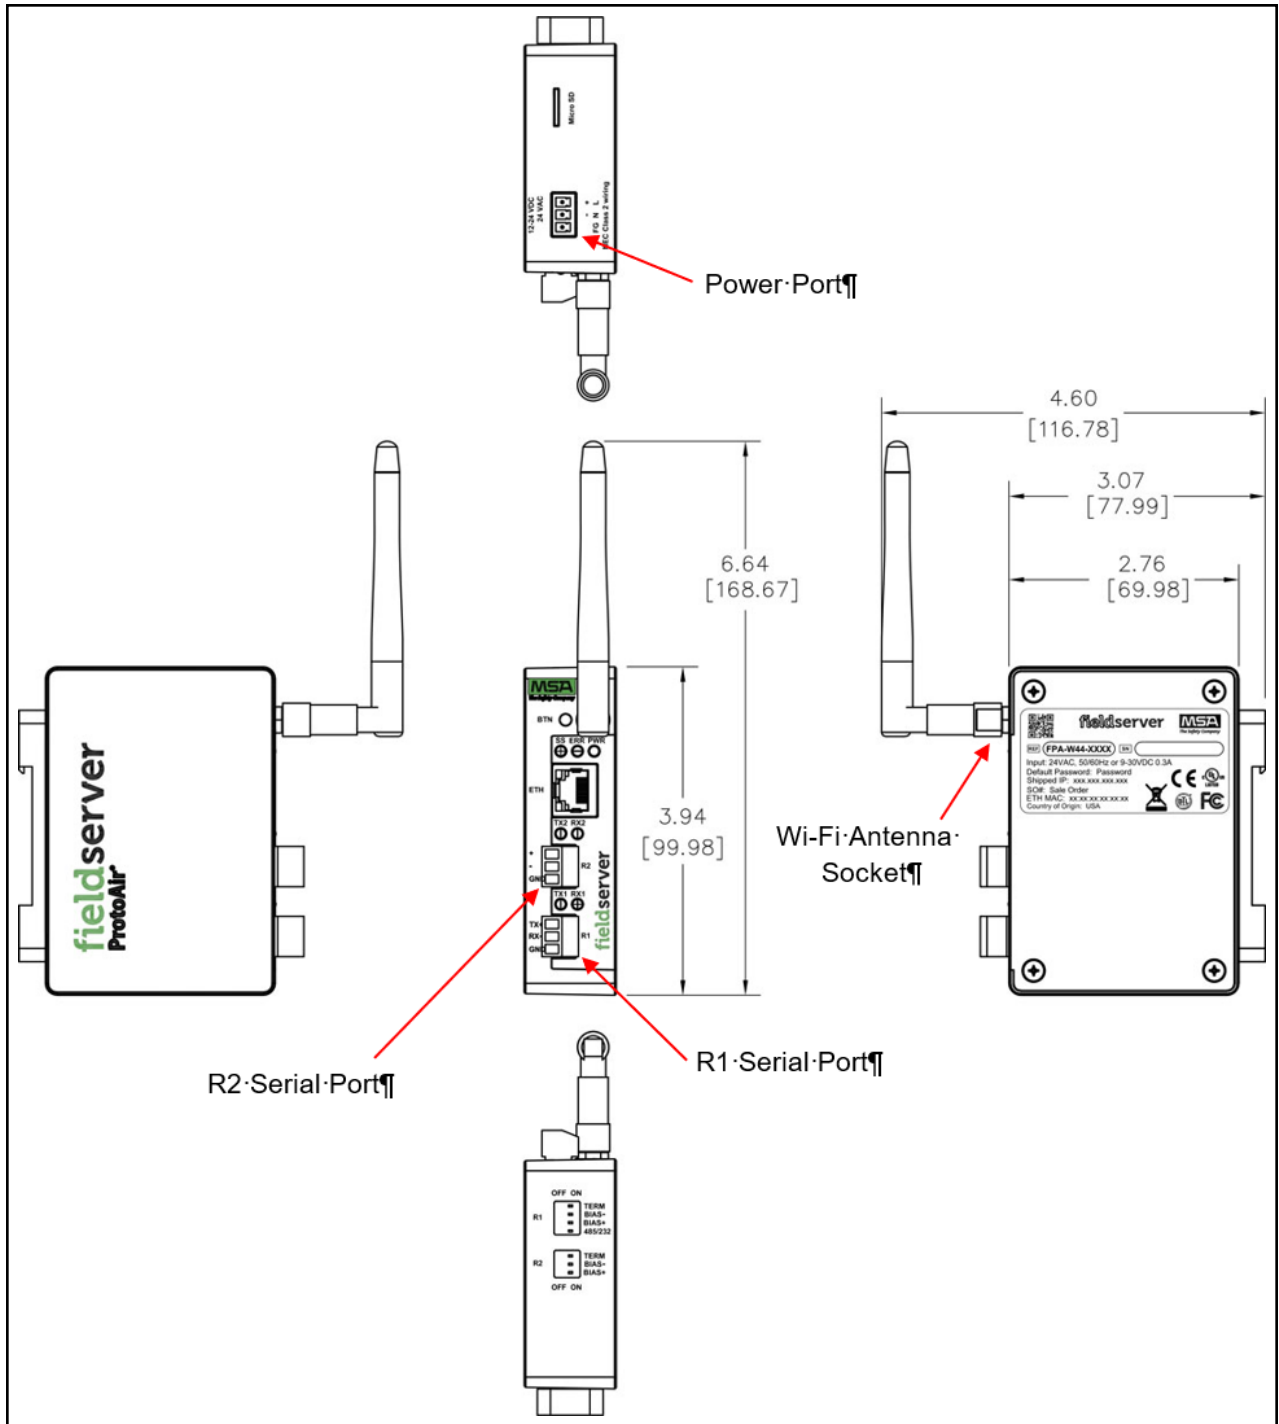


3 Installation

3.1 Connecting the R1 & R2 Ports

The R1 and R2 Ports are RS-485.

NOTE: For the R1 Port, ensure RS-485 is selected by checking the number 4 DIP Switch is set to the left side.

Connect to the 3-pin connector(s) as shown below.

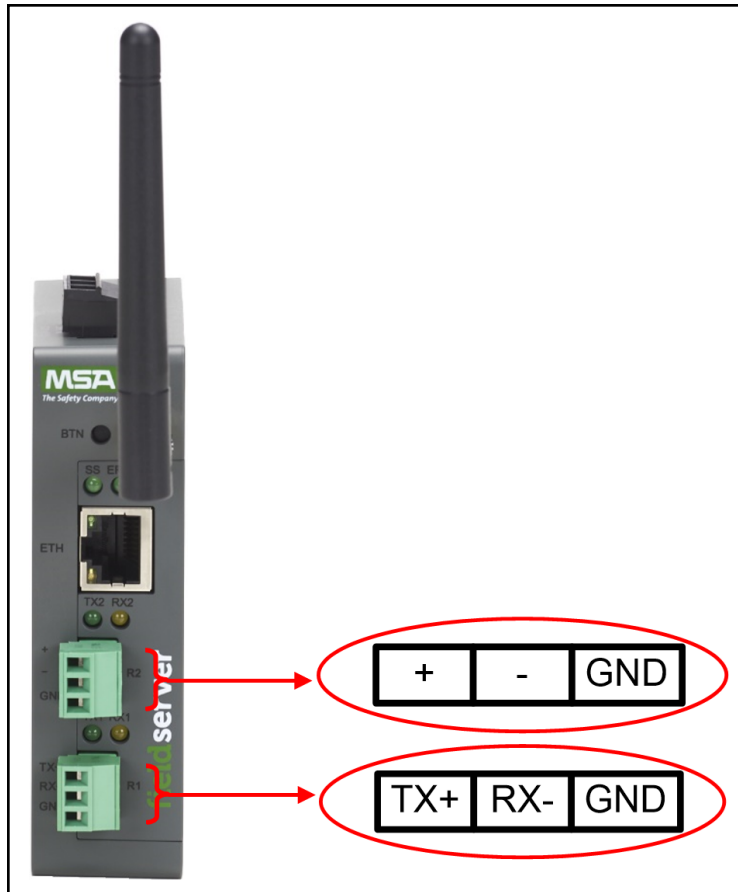

The following baud rates are supported:

9600, 19200, 38400, 76800


3.1.1 Wiring

RS-485	
BMS RS-485 Wiring	Gateway Pin Assignment
RS-485 +	TX +
RS-485 -	RX -
GND	GND

NOTE: Use standard grounding principles for GND.

3.2 10/100 Ethernet Connection Port

NOTE: Do not use shielded Ethernet cables.

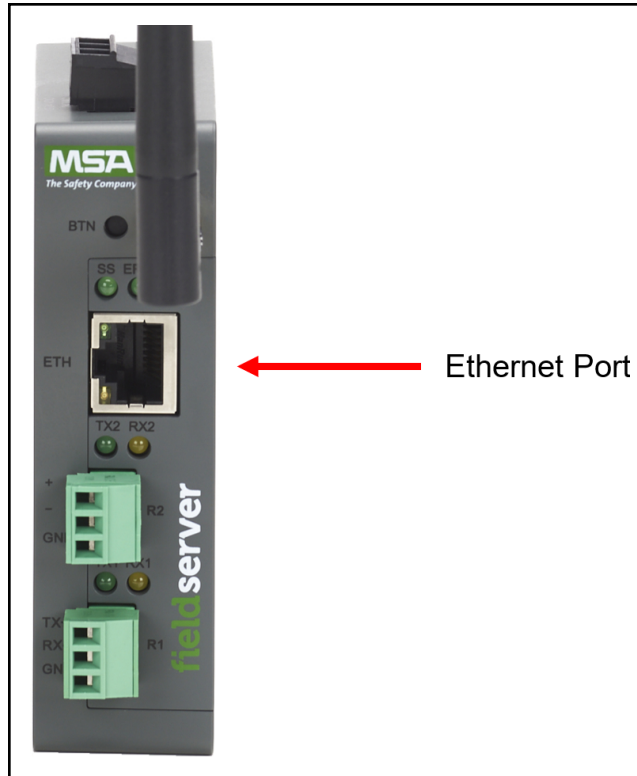

The Ethernet Port is used both for Ethernet protocol communications and for configuring the gateway via the Web App. To connect the gateway, either connect the PC to the router's Ethernet port or connect the router and PC to an Ethernet switch. Use Cat-5 cables for the connection.

NOTE: The Default IP Address of the gateway is 192.168.2.101, Subnet Mask is 255.255.255.0.

4 Power up the Gateway


Check power requirements in the table below:

Power Requirement for BACnet Router External Gateway		
BACnet Router Family	Current Draw Type	
	12VDC	24VDC/AC
FS-ROUTER-BACW (Typical)	250mA	125mA

NOTE: These values are 'nominal' and a safety margin should be added to the power supply of the host system. A safety margin of 25% is recommended.

Apply power to the BACnet Router as shown below. Ensure that the power supply used complies with the specifications provided in [Section 12.3 Specifications](#) .

- The gateway accepts 9-30VDC or 24VAC on pins L+ and N-.
- Frame GND should be connected.

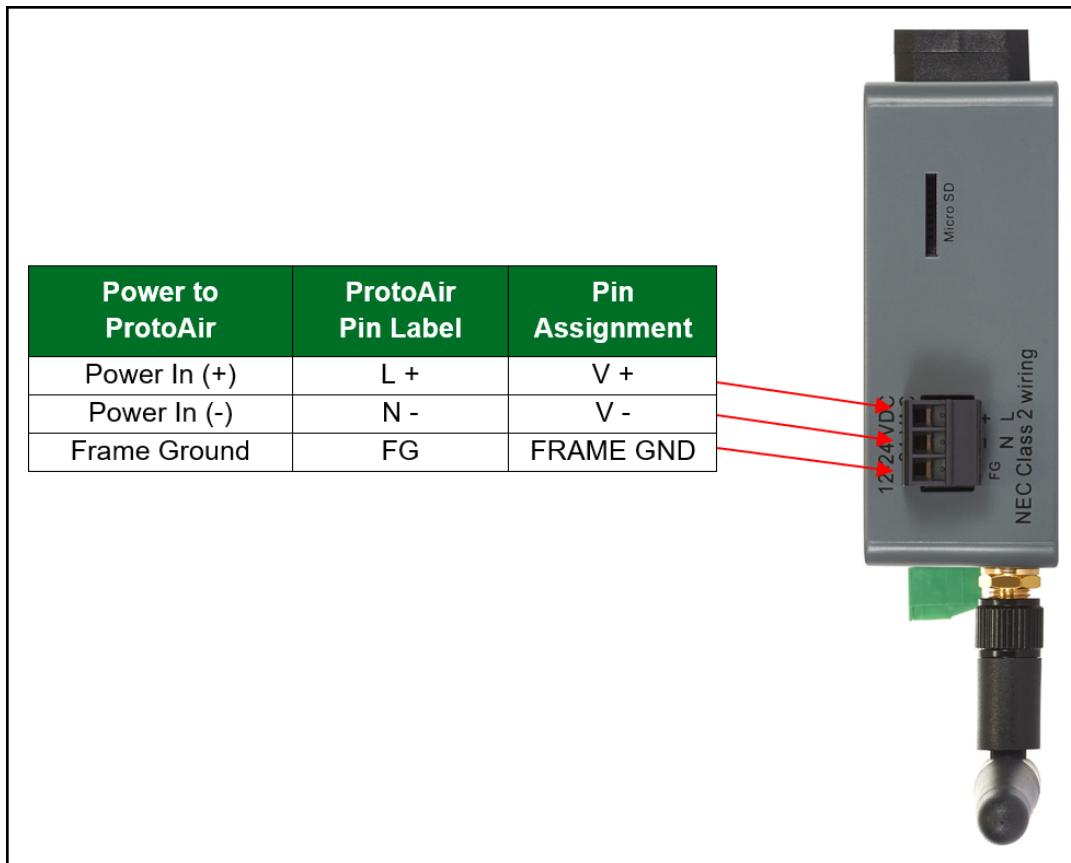


5 Connecting to the BACnet Router

The FieldServer Toolbox Application can be used to discover and connect to the BACnet Router on a local area network. To manually connect to the BACnet Router using the Toolbox, click on the plus icon next to the "Devices" header and enter the IP Address, or enter the Internet IP Address into a web browser.

5.1 Using the FieldServer Toolbox to Discover and Connect to the BACnet Router

- Install the Toolbox application from the USB drive or download it from the MSA Safety website.
- Use the FS Toolbox application to find the BACnet Router and connect to the BACnet Router.

NOTE: If the connect button is grayed out, the BACnet Router's IP Address must be set to be on the same network as the PC. (Section [5.2 Using a Web Browser](#))

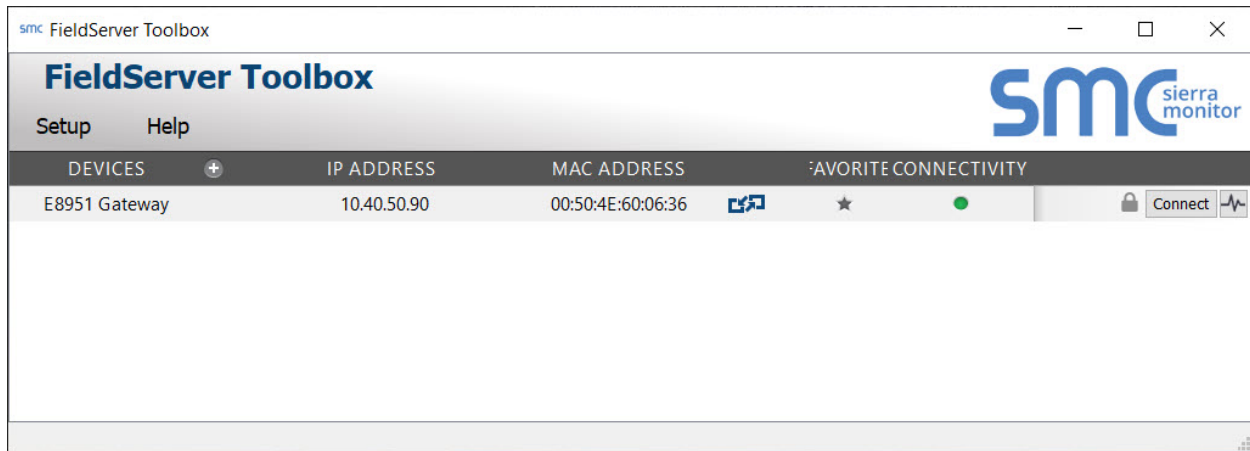

5.2 Using a Web Browser

- Open a web browser and connect to the BACnet Router's default IP Address. The default IP Address of the BACnet Router is **192.168.2.101**, Subnet Mask is **255.255.255.0**.
- If the PC and the BACnet Router are on different IP networks, assign a static IP Address to the PC on the 192.168.2.X network.


NOTE: Check Section [11.4 Internet Browser Software Support](#) for supported browsers.

6 Setup Web Server Security


6.1 Login to the FieldServer

The first time the FieldServer GUI is opened in a browser, the IP Address for the gateway will appear as untrusted. This will cause the following pop-up windows to appear.


- When the Web Server Security Unconfigured window appears, read the text and choose whether to move forward with HTTPS or HTTP.

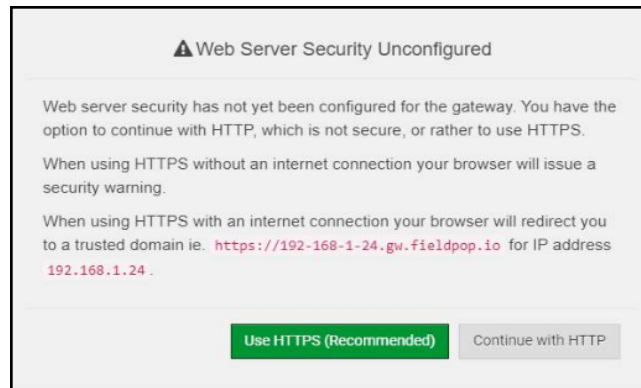

- When the warning that "Your connection is not private" appears, click the advanced button on the bottom left corner of the screen.

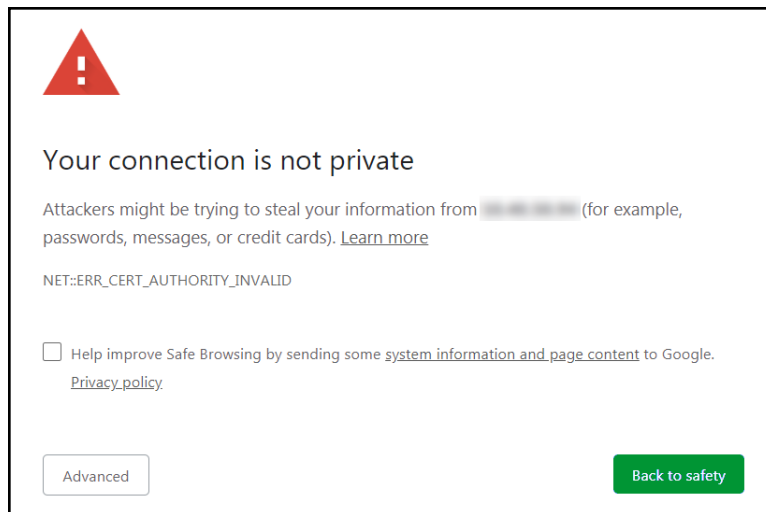


- Additional text will expand below the warning, click the underlined text to go to the IP Address. In the example below this text is “Proceed to <FieldServer IP> (unsafe)”.

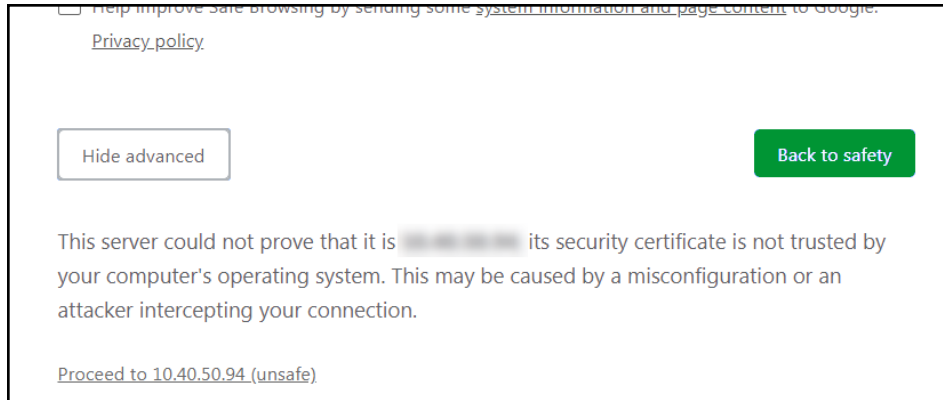

- When the login screen appears, put in the Username (default is “admin”) and the Password (found on the label of the FieldServer).

NOTE: There is also a QR code in the top right corner of the FieldServer label that shows the default unique password when scanned.

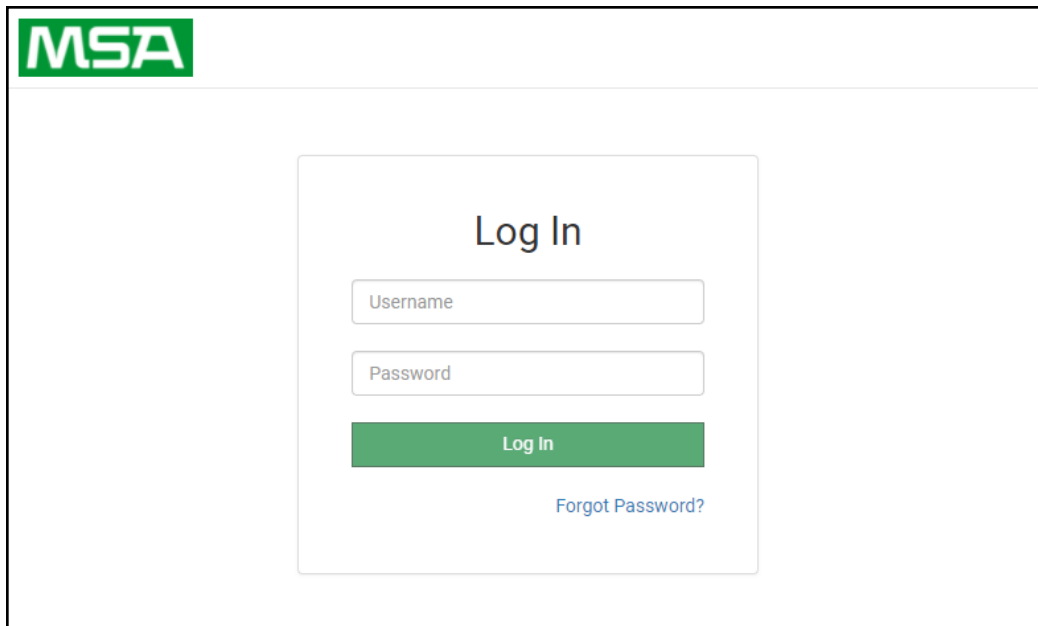


NOTE: A user has 5 attempts to login then there will be a 10-minute lockout. There is no timeout on the FieldServer to enter a password.

NOTE: To create individual user logins, go to Section [12.2 Change User Management Settings](#).

6.2 Select the Security Mode

On the first login to the FieldServer, the following screen will appear that allows the user to select which mode the FieldServer should use.

Web server security is not configured



Please select the web security profile from the options below.

Note that browsers will issue a security warning when browsing to a HTTPS server with an untrusted self-signed certificate.

Mode

- HTTPS with default trusted TLS certificate (requires internet connection to be trusted)
- HTTPS with own trusted TLS certificate
- HTTP (not secure, vulnerable to man-in-the-middle attacks)

Save

NOTE: Cookies are used for authentication.

NOTE: To change the web server security mode after initial setup, go to [Section 12.1 Change Web Server Security Settings After Initial Setup](#).

The sections that follow include instructions for assigning the different security modes.

6.2.1 HTTPS with Own Trusted TLS Certificate

This is the recommended selection and the most secure. **Please contact your IT department to find out if you can obtain a TLS certificate from your company before proceeding with the Own Trusted TLS Certificate option.**

- Once this option is selected, the Certificate, Private Key and Private Key Passphrase fields will appear under the mode selection.

Certificate

```
XzyMbQZFIRuJZJPe7CTHLcHORHlowoUFoVTaBMYd4d6VGdNklKazByWKcNOL7mrX
A4IBAQBfM+IPvOx3T/47VEmaiXqE3bx3zEuBFJ6pWPlw7LHf2r2ZoHw+9xb+aNMU
dVYAelhBMTMsnI2ERvQVp0xj3psSv2EJyKXS1bOYNRLsq7UzpwuAdT/Wy3o6vUM5
K+Cwf9qEoQ0LuxDZTIECT67MkcHMiuFi5pk7TRicHnQF/sfOAYOulduHOy9exlk9
FmHFVDIZf/cJUaF+e74EuSph+gEr0IQo2wmmhyc7L22UXse1NoOfUJ2Zq0Eu1Vvtu
JRryaMWIRFEWuuzMGZfKEWVC+8q2JQsVcqiRWM7naoblEhOCMH+sKHJMCxDoXGt
vtZjpZUoAL51YXxWSVcyZdGiAP5e
-----END CERTIFICATE-----
```

Private Key

```
sHB0zZoHr4YQSDK2BbYVzZbI0LDuKtc8+JiO3ooGjoTuHnqkeAj/fKfbTAsKeAzw
gKQe+H5UQNk0bdvZfOJrm6daDK2vVdmR5k+juUUhEj5N49uplroB97MQgYotzqfT+
THlbpq5t1SIK617k04ObKmHF5l8fck+ru545sVmpeezh0m5j5SURYAZMvbq5daCu
J4l5NIihbEvxRF4UK41ZDMCvujopCkBUWrb1a/3XXnDnM2K9xyz2wze998D6Wk46
+7aOFY9F+7j5lJmnkoS3GYtwCyH5jP+mPP1K6RnuiD019wvGPb4dtN/RTnfd0eF
GYeVSkI9fxkxDOFtdWRZbM/rPin4tmO1Xf8HqONVN1x/iaMynOXG4cukoI4+VO
u0rZaUESll2zNkfrn7fAASm5NBWg202Cy9IAYnuujs3aALl5uGBEEK62oTMxlzx
-----END RSA PRIVATE KEY-----
```

Private Key Passphrase

- Copy and paste the Certificate and Private Key text into their respective fields. If the Private Key is encrypted type in the associated Passphrase.
- Click Save.
- A “Redirecting” message will appear. After a short time, the FieldServer GUI will open.

6.2.2 HTTPS with Default Untrusted Self-Signed TLS Certificate or HTTP with Built-in Payload Encryption

- Select one of these options and click the Save button.
- A “Redirecting” message will appear. After a short time, the FieldServer GUI will open.

7 Setup Network

Navigate to the Network Settings tab and configure the settings as needed.

The screenshot displays the MSA BACnet Router configuration interface. On the left is a navigation sidebar with the following items: BACnet Router, BACnet Explorer, Network Settings (highlighted), Router Diagnostics, FieldServer Manager, About, and Logout. The main content area is divided into several sections:

- BACnet Device:** Fields for Device Name (BACnet Router), Device Instance (1000), Device Location (-), and Device Connection (BACnet IP Wired 1).
- BACnet Ethernet:** Includes an Enable checkbox (unchecked) and Network Number (3).
- BACnet IP Wired 1:** Includes an Enable checkbox (checked), Network Number (1), and IP Port (47808).
- BACnet IP Wired 2:** Includes an Enable checkbox (unchecked), Network Number (2), and IP Port (47809).
- BACnet IP BBMD:** Section header with no visible fields.
- BACnet MSTP Settings:** Includes Max Info Frames (50) and Max Master (127).
- BACnet MSTP R1:** Includes an Enable checkbox (unchecked), Network Number (4), MAC Address (0), Baud Rate (38400), and Token Usage Timeout (50).
- BACnet MSTP R2:** Includes an Enable checkbox (unchecked).

On the right side of the interface, there are control buttons: Save (green), Restart (green), Reload (grey), and Defaults (grey). Below these are two status boxes: "Status" showing "Router is online" and "Log".

At the bottom of the interface, the text "Copyright © MSA Safety - Diagnostics" is on the left and the "fieldserver" logo is on the right.

7.1 Ethernet 1

To change the FieldServe IP Settings, follow these instructions:

- Enable DHCP to automatically assign IP Settings or modify the IP Settings manually as needed, via these fields: IP Address, Netmask, Default Gateway, and Domain Name Server1/2.

NOTE: If the FieldServer is connected to a router, the IP Gateway of the FieldServer should be set to the same IP Address of the router.

- Click Save to record and activate the new IP Address.
- Connect the FieldServer to the local network or router.

NOTE: The browser needs to be updated to the new IP Address of the FieldServer before the settings will be accessible again.

ETH 1 WiFi Client WiFi Access Point Routing

Enable DHCP

IP Address

Netmask

Gateway

Domain Name Server 1 (Optional)

Domain Name Server 2 (Optional)

Network Status

Connection Status	✔ Connected
MAC Address	00:50:4e:60:01:fd
Ethernet Tx Msgs	498,827
Ethernet Rx Msgs	1,384,116
Ethernet Tx Msgs Dropped	0
Ethernet Rx Msgs Dropped	0

7.1.1 Wi-Fi Client Settings

- Set the Wi-Fi Status to ENABLED for the BACnet Router to communicate with other devices via Wi-Fi.
- Enter the Wi-Fi SSID and Wi-Fi Password for the local wireless access point.
- Enable DHCP to automatically assign all Wi-Fi Client Settings fields or modify the Settings manually, via the fields immediately below the note (IP Address, Network, etc.).

NOTE: If connected to a router, set the IP gateway to the same IP Address as the router.

- Click the Save button to activate the new settings.
- Go to Routing ([Section 7.1.3 Routing Settings](#)) to set the default connection to Wi-Fi Client.

The screenshot displays the configuration interface for the BACnet Router, specifically the Wi-Fi Client settings page. The interface is divided into two main sections: configuration fields on the left and a Network Status summary on the right.

Configuration Fields:

- Enable:** A checked checkbox.
- SSID:** A text input field containing "FieldSVR".
- Password (Optional):** A password input field with a toggle for visibility.
- Enable DHCP:** A checked checkbox.
- IP Address:** A text input field containing "10.40.50.37".
- Netmask:** A text input field containing "255.255.255.0".
- Gateway:** A text input field containing "10.40.50.1".
- Domain Name Server 1 (Optional):** A text input field containing "10.5.4.77".
- Domain Name Server 2 (Optional):** A text input field containing "10.40.2.24".

Network Status Summary:

Network Status	
Connection Status	Connected
MAC Address	A0:CC:2B:FF:AB:59
WiFi BSSID	78:BC:1A:52:C8:42
WiFi Channel	2,462
WiFi Tx Msgs	1,484
WiFi Rx Msgs	1,799
WiFi Tx Msgs Dropped	0
WiFi Rx Msgs Dropped	16
WiFi Pairwise Cipher	CCMP
WiFi Group Cipher	CCMP
WiFi Key Mgmt	WPA2-PSK
WiFi Link	19.5 MBit/s MCS 2
WiFi Signal Level	-86 dBm

At the bottom of the configuration section, there are two buttons: "Cancel" and "Save".

7.1.2 Wi-Fi Access Point Settings

- Check the Enable tick box to allow connecting to the BACnet Router via Wi-Fi Access Point.
- Modify the Settings manually as needed, via these fields: SSID, Password, Channel, IP Address, Netmask, IP Pool Address Start, and IP Pool Address End.

NOTE: The default channel is 11. The default IP Address is 192.168.50.1.

- Click the Save button to activate the new settings.

NOTE: If the webpage was open in a browser via Wi-Fi, the browser will need to be updated with the new Wi-Fi details before the webpage will be accessible again.

ETH 1 WiFi Client **WiFi Access Point** Routing

Enable

SSID
ProtoAir-6001FD

Password (Optional)
.....

Channel
11

Allow others to find this network

Enable hotspot

IP Address
192.168.50.1

Netmask
255.255.255.0

IP Pool Address Start
192.168.50.120

IP Pool Address End
192.168.50.130

Cancel Save

Network Status

Connection Status	Disabled
Access Point MAC Address	a0:cc:2b:ff:ab:59
Access Point Tx Msgs	0
Access Point Rx Msgs	0
Access Point Tx Msgs Dropped	0
Access Point Rx Msgs Dropped	0

7.1.3 Routing Settings

The Routing settings make it possible to set up the IP routing rules for the FieldServer's internet and network connections.

NOTE: The default connection is ETH1.

- Select the default connection in the first row.
- Click the Add Rule button to add a new row and set a new Destination Network, Netmask and Gateway IP Address as needed.
- Set the Priority for each connection (1-255 with 1 as the highest priority and 255 as the lowest).
- Click the Save button to activate the new settings.

NOTE: If using Wi-Fi Client and not Ethernet, make the top priority rule a Wi-Fi Client connection.

ETH 1 WiFi Client WiFi Access Point Routing

Set up the IP routing rules of your FieldServer for internet access and access to other networks.

If you want to reach another device that is not connected to the local network, you can add a rule to determine on which gateway the device must be routed to.

Interface	Destination Network	Netmask	Gateway IP Address	Priority ?
WiFi Client	Default	-	10.40.50.1	255
ETH 1	10.40.50.10	255.255.255.255	10.40.50.1	100


+ Add Rule

Cancel Save


8 Configuring the BACnet Router

8.1 Navigate to the BACnet Router Settings

- From the Web App landing page, click the BACnet Router tab on the left side of the screen.

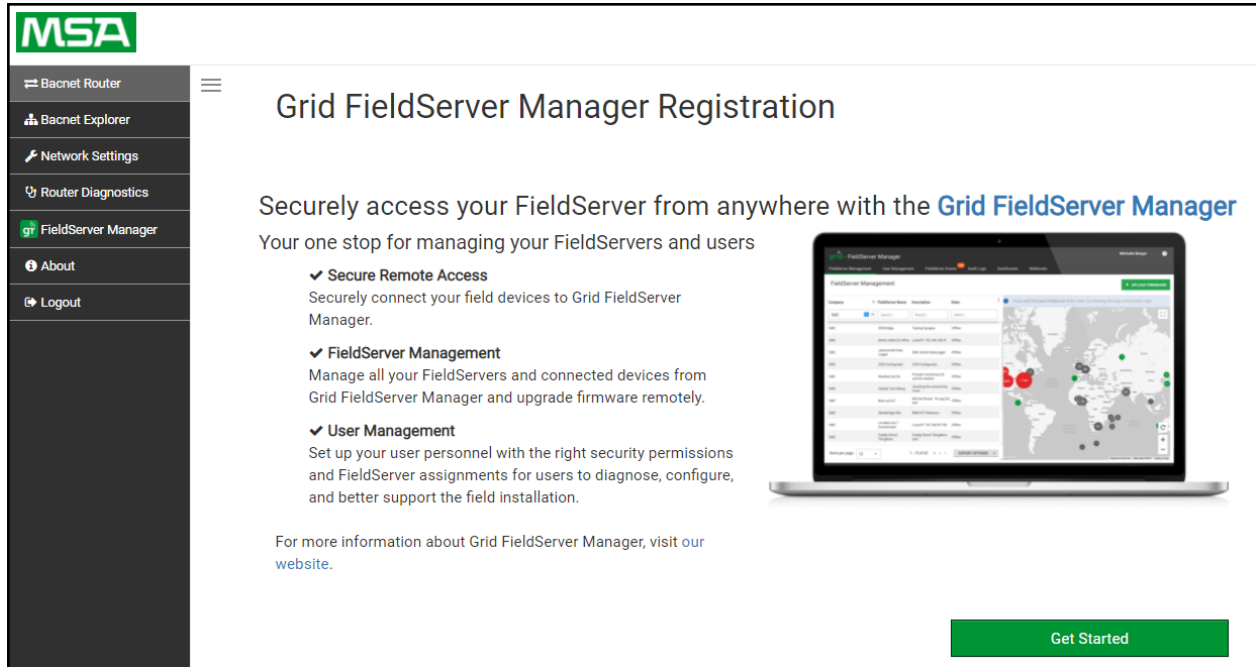

- A warning message will appear when performing the first-time setup, click the Exit Registration button to continue to the Settings page.

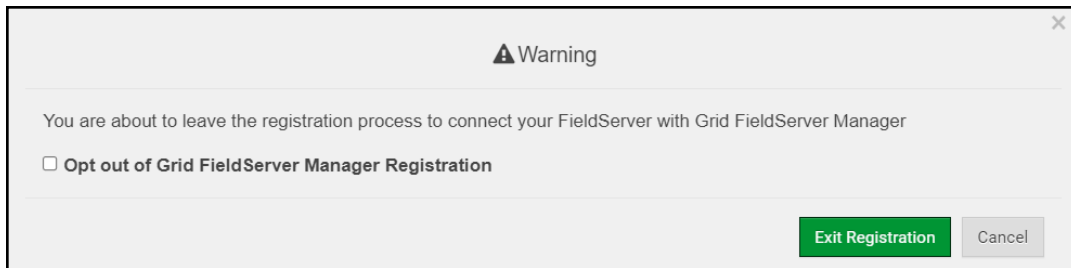

8.2 BACnet Router Settings

MSA

BACnet Router

BACnet Explorer

Network Settings

Router Diagnostics

FieldServer Manager

About

Logout

BACnet Device

Device Name: BACnet Router

Device Instance: 1000

Device Location: -

Device Connection: BACnet IP Wired 1

BACnet IP Wired 1

Enable:

Network Number: 1

IP Port: 47808

BACnet IP Wired 2

Enable:

Network Number: 2

IP Port: 47809

BACnet IP BBMD

BACnet Ethernet

Enable:

Network Number: 3

BACnet MSTP Settings

Max Info Frames: 50

Max Master: 127

BACnet MSTP R1

Enable:

Network Number: 4

MAC Address: 0

Baud Rate: 38400

Token Usage Timeout (ms): 50

BACnet MSTP R2

Enable:

Save

Restart

Reload

Defaults

Status

Router is online

Log

Copyright © MSA Safety - Diagnostics

fieldserver

8.2.1 Button Functions

Save

Restart

Reload

Defaults

- **Save** – write the currently displayed settings to the device. A restart will be required to apply the updated settings.
- **Reload** – discard the currently displayed settings and reload the settings stored on the device. This will undo any unsaved edits.
- **Defaults** – discard the currently displayed settings and load default settings. This must still be saved and the device must be restarted for the default settings to be applied.
- **Restart** – restarts the device.


8.2.2 Multiple Connections

- **Network Number** – set up the BACnet network number for the connection. Legal values are 1-65534. Each network number must be unique across the entire BACnet internetwork. . All devices that are interconnected by the same IP network and that can reach one another through local IP broadcasts (including local IP broadcasts forwarded by BBMD) should be treated as a single BACnet network segment, and hence all routing ports connected to this segment should have the same globally unique network number.

NOTE: Each BACnet network segment, regardless of technology, must have a unique network number. For example, a single RS-485 MS/TP segment or BACnet/IP subnet, can each be regarded as a BACnet network segment. All routing ports that connect directly to the same segment should also assign the same globally unique network number to that segment.

- **Enable** – enable or disable the connection; note that BACnet/IP Primary is always enabled.

8.2.3 BACnet Device

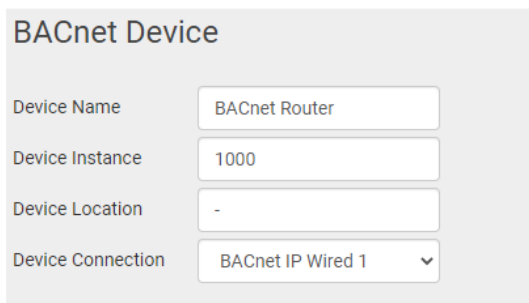

The screenshot shows a configuration form titled "BACnet Device" with four fields:

Field Label	Value
Device Name	BACnet Router
Device Instance	1000
Device Location	-
Device Connection	BACnet IP Wired 1

- **Device Instance** and **Device Name** – a BACnet Router must provide a Device Object. Configure its name and Instance Number here. Take care to select a Device Instance Number that is unique across the entire BACnet internetwork.
- **Device Location** – enter a location for the Device. The location may not contain any commas.
- **Device Connection** – select which connection to bond the BACnet device settings.

8.2.4 BACnet/IP

BACnet IP Wired 1

Enable

Network Number

IP Port

BACnet IP Wired 2

Enable

Network Number

IP Port

BACnet IP WiFi

Enable

Network Number

IP Port

BACnet IP BBMD

Enable

BBMD Connection

Public IP Address

Public IP Port

Edit BDT

- **IP Port** – the BACnet/IP default is 47808 (0xBAC0), but a different port number may be specified here.
- **IP Port** – this MUST be different to the IP Port used on the BACnet/IP Primary connection. Default is 47809 (0xBAC1).
- **BBMD Connection** – select which connection to bond the BACnet/IP BBMD settings.
- **Public IP Address and Port** – if the BBMD is being accessed across a NAT Router, then these values must be configured with the public IP Address and Port by which the BBMD can be reached from across the NAT Router. The Public IP Address and Port would also be used in the BDT of remote BBMD's that need to reach this BBMD across the NAT Router. If no NAT Router is being used, these fields can be left blank. For example, type into a Google browser “my IP Address” to see the local PC’s Public IP Address.

8.2.5 BACnet MS/TP, BACnet Ethernet and BACnet Explorer

BACnet Ethernet

Enable

Network Number

BACnet MSTP Settings

Max Info Frames

Max Master

BACnet MSTP R1

Enable

Network Number

MAC Address

Baud Rate

Token Usage Timeout (ms)

BACnet MSTP R2

Enable

Network Number

MAC Address

Baud Rate

Token Usage Timeout (ms)

BACnet Explorer

Network Number

- **Max Info Frames** – the number of transactions the Router may initiate while it has the MS/TP token. Default is 50.
- **Max Master** – the highest MAC address to scan for other MS/TP master devices. The default of 127 is guaranteed to discover all other MS/TP master devices on the network.
- **MAC Address** – legal values are 0 to 127, must be unique on the physical network.
- **Baud Rate** – the serial baud rate used on the network.
- **Token Usage Timeout (ms)** – the number of milliseconds the router will wait before deciding that another master has dropped the MS/TP token. This value must be between 20ms and 100ms. Choose a larger value to improve reliability when working with slow MS/TP devices that may not be able to meet strict timing specifications.

8.3 Router Diagnostics

By clicking on the Router Diagnostics tab all the connection communication details can be viewed to ensure the BACnet Router is working correctly.

The screenshot displays the MSA FieldServer Manager interface. On the left is a dark sidebar with navigation options: Bacnet Router, Bacnet Explorer, Network Settings, Router Diagnostics (highlighted), FieldServer Manager, About, and Logout. The main content area is titled 'ETH1 - BACnet IP Wired 1'. It shows network statistics for Network Number 1: Messages Sent (270), Messages Received (280), and Total Errors (0). Below this is a 'Routing Table' with columns for DNET, MAC Address, and Status. The table lists ten entries, all with a status of 'Available'. The second network shown is 'ETH1 - BACnet Explorer 47800', with Network Number 7, Messages Sent (258), Messages Received (246), and Total Errors (0). Its routing table is empty. The footer contains the copyright notice 'Copyright © MSA Safety - Diagnostics' and the 'fieldserver' logo.

DNET	MAC Address	Status
5	10.40.51.113:47808	Available
6	10.40.50.80:47808	Available
50	10.40.50.103:47808	Available
181	10.40.50.181:47808	Available
1100	10.40.50.73:47808	Available
1200	10.40.50.73:47808	Available
50001	10.40.50.88:47808	Available
50003	10.40.50.88:47808	Available
60003	10.40.50.116:47808	Available

Network Number	Messages Sent	Messages Received	Total Errors
7	258	246	0

9 BACnet Explorer

The embedded BACnet Explorer allows installers to validate that their equipment is working on BACnet without having to ask the BMS integrator to test the unit.


- To access the embedded BACnet Explorer, click the BACnet Explorer tab.


The screenshot displays the MSA BACnet Explorer web interface. On the left is a dark sidebar with navigation links: BACnet Router, BACnet Explorer, Network Settings, Router Diagnostics, FieldServer Manager, About, and Logout. The main content area is divided into several configuration panels. The 'BACnet Device' panel includes fields for Device Name (BACnet Router), Device Instance (1000), Device Location (-), and Device Connection (BACnet IP Wired 1). Below it are 'BACnet IP Wired 1' and 'BACnet IP Wired 2' panels, each with an 'Enable' checkbox, 'Network Number' field, and 'IP Port' field. The 'BACnet Ethernet' panel has an 'Enable' checkbox and a 'Network Number' field (3). The 'BACnet MSTP Settings' panel includes 'Max Info Frames' (50) and 'Max Master' (127). The 'BACnet MSTP R1' panel has an 'Enable' checkbox, 'Network Number' (4), 'MAC Address' (0), 'Baud Rate' (38400), and 'Token Usage Timeout (ms)' (50). The 'BACnet MSTP R2' panel has an 'Enable' checkbox. On the right side, there are 'Save' and 'Restart' buttons in green, and 'Reload' and 'Defaults' buttons in grey. Below these is a 'Status' section showing 'Router is online' and a 'Log' section. The footer contains 'Copyright © MSA Safety - Diagnostics' and the 'fieldserver' logo.


NOTE: For BACnet/IP, click on the Settings button on the left side of the landing page to ensure the BACnet Router is on the BACnet/IP network subnet to configure BBMD.

9.1 Discover the Device List

- From the BACnet Explorer landing page, click on the BACnet Explorer tab on the left side of the screen to go to the BACnet Explorer page.

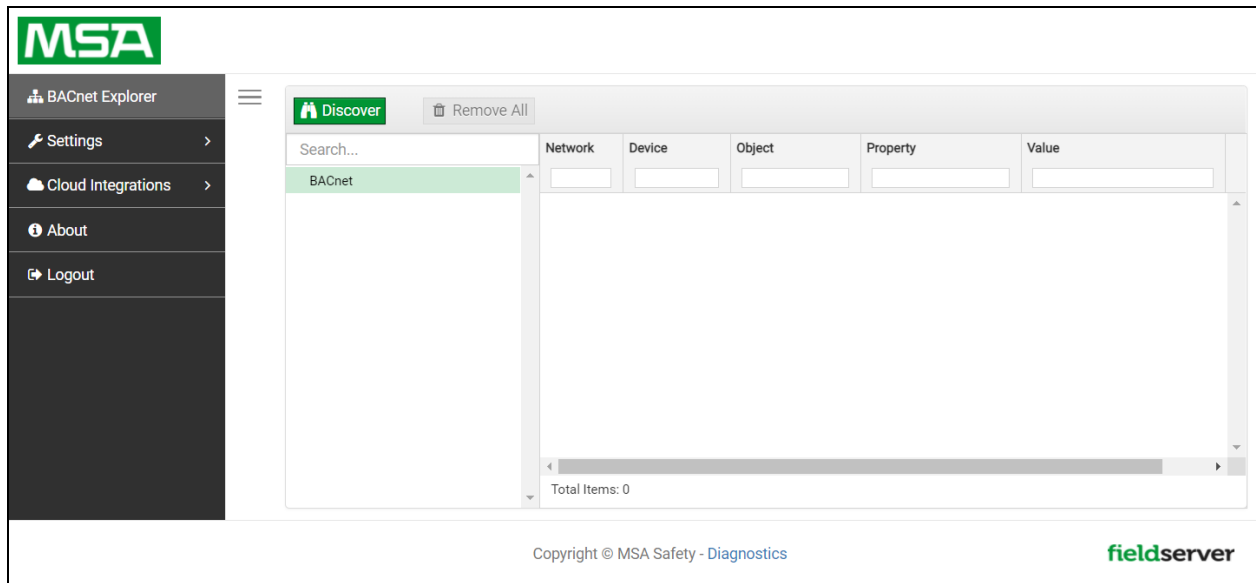

- Find devices connected to the same subnet as the gateway by clicking the Discover button  (binocular icon).
- This opens the Discover window, click the checkboxes next to the desired settings and click Discover to start the search.

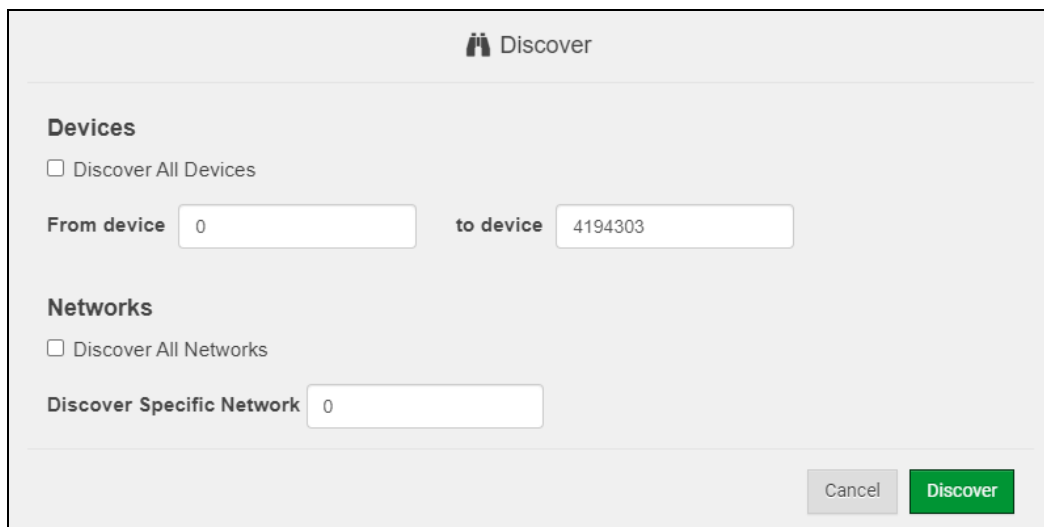

NOTE: The “Discover All Devices” or “Discover All Networks” checkboxes must be unchecked to search for a specific device range or network.

Allow the devices to populate before interacting with the device list for optimal performance. Any discovery or explore process will cause a green message to appear in the upper right corner of the browser to confirm that the action is complete.

The screenshot shows the 'Discover' interface with a search bar and a list of devices. The table below represents the data shown in the interface.

Device	Object	Property	Value	Monitor
1 (FAP_1)	device:1 (FAP_1)	max-apdu-length-accepted	1458	Off
1 (FAP_1)	device:1 (FAP_1)	object-name	FAP_1	Off
1 (FAP_1)	device:1 (FAP_1)	vendor-identifier	37	Off
18100 (BASRTLX-B-01C6AF)	device:18100 (BASRTLX-B-01C...	max-apdu-length-accepted	1476	Off
18100 (BASRTLX-B-01C6AF)	device:18100 (BASRTLX-B-01C...	object-name	BASRTLX-B-01C6AF	Off
18100 (BASRTLX-B-01C6AF)	device:18100 (BASRTLX-B-01C...	vendor-identifier	245	Off
50001	device:50001	max-apdu-length-accepted	1458	Off
50001	device:50001	vendor-identifier	37	Off
54321 (SENTRY_BAC_11)	device:54321 (SENTRY_BAC_11)	max-apdu-length-accepted	1458	Off
54321 (SENTRY_BAC_11)	device:54321 (SENTRY_BAC_11)	object-name	SENTRY_BAC_11	Off
54321 (SENTRY_BAC_11)	device:54321 (SENTRY_BAC_11)	vendor-identifier	37	Off
259645 (WeatherLink_1)	device:259645 (WeatherLink_1)	max-apdu-length-accepted	1458	Off
259645 (WeatherLink_1)	device:259645 (WeatherLink_1)	object-name	WeatherLink_1	Off
259645 (WeatherLink_1)	device:259645 (WeatherLink_1)	vendor-identifier	37	Off

Total Items: 42 (Showing Items: 14)


9.2 View Device Details and Explore Points/Parameters


- To view the device details, click the blue plus sign (+) next to the desired device in the list.
 - This will show only some of the device properties for the selected aspect of a device

The screenshot shows the 'Discover' interface with the '259645 (WeatherLink_1)' device selected. The table below represents the data shown in the interface.


Object	Property	Value	Monitor
device:259645 (WeatherLink_1)	max-apdu-length-accepted	1458	Off
device:259645 (WeatherLink_1)	object-name	WeatherLink_1	Off
device:259645 (WeatherLink_1)	vendor-identifier	37	Off

Total Items: 42 (Showing Items: 3)


- To view the full details of a device, highlight the device directly (in the image below – “1991 WeatherLink_1”) and click the Explore button () that appears to the right of the highlighted device as a magnifying glass icon or double-click the highlighted device.

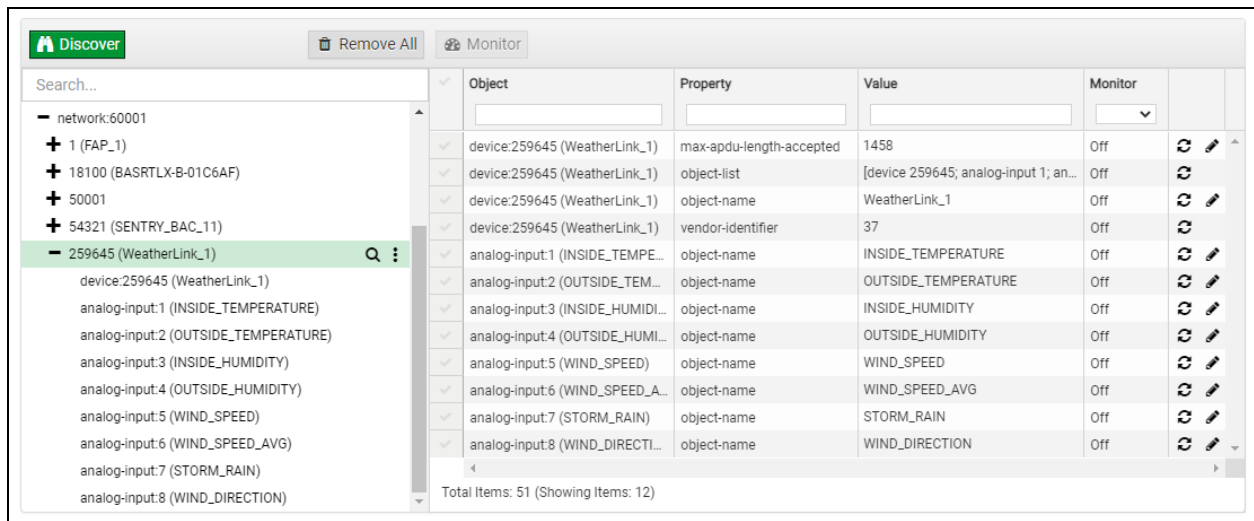

- Now additional device details are viewable; however, the device can be explored even further
- Click on one of the device details.

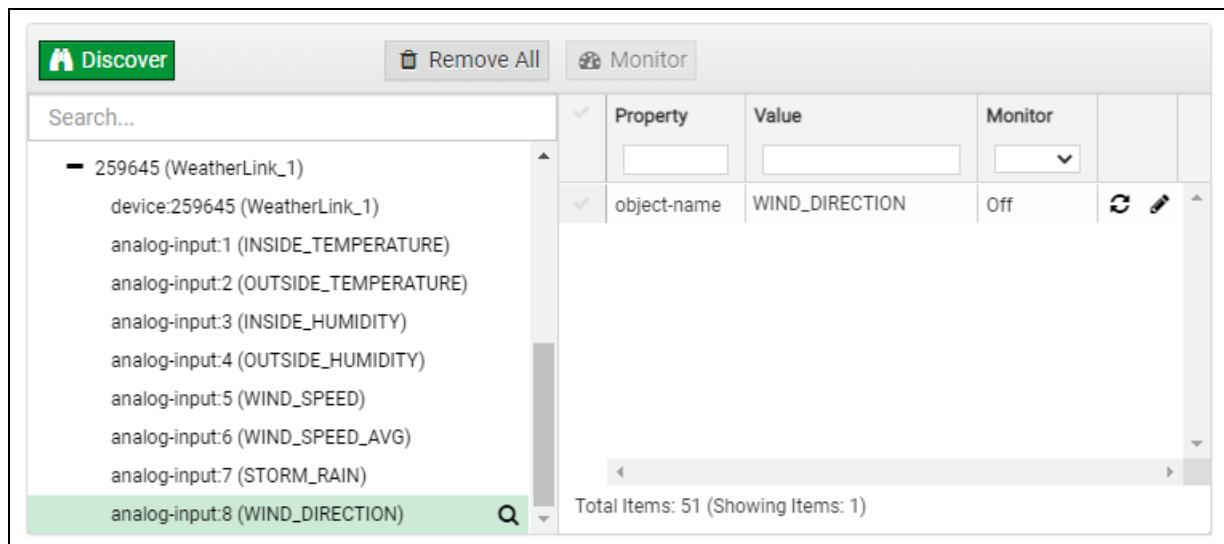

- Then click on the Explore button that appears or double-click the device object.

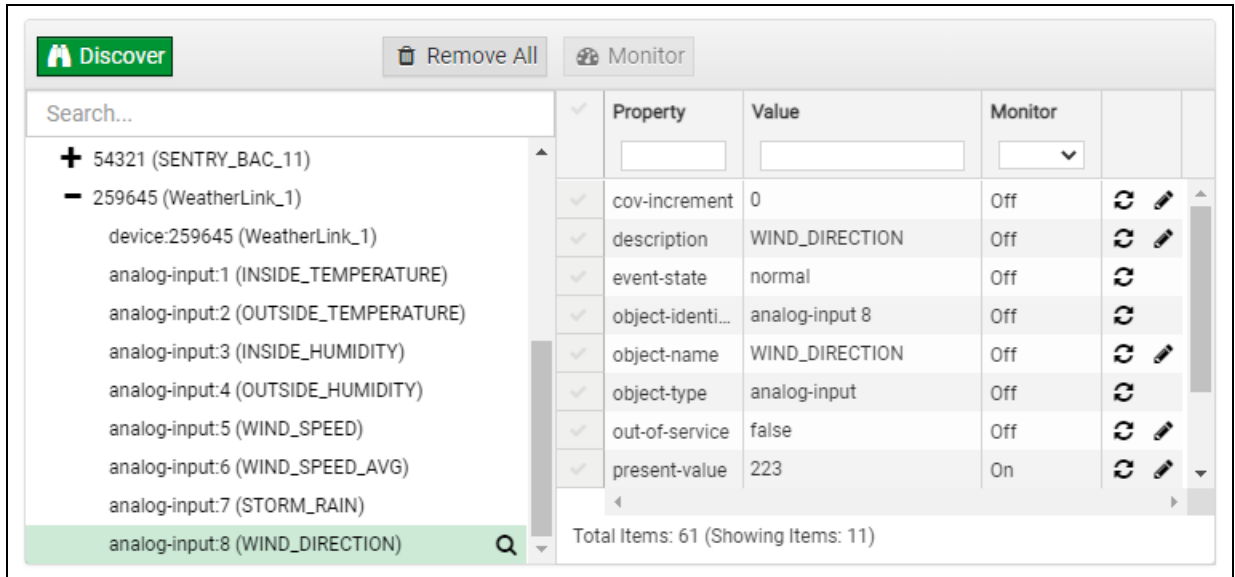

A full list of the device details will appear on the right side window. If changes are expected since the last explore, simply press the Refresh button (🔄) that appears to right of individual properties to refresh.

NOTE: The Gateway Search Bar will find devices based on their Device ID.

NOTE: The Gateway Discovery Tree has 3 levels that correspond to the following.


- Network number
 - Device
 - Device object

9.2.1 Edit the Present Value Field

The only recommended field to edit is the device's present value field.


NOTE: Other BACnet properties are editable (such as object name, object description, etc.); however, this is not recommended because the gateway is not a Building Management System (BMS).

- To edit the present value, select it in the property listings.

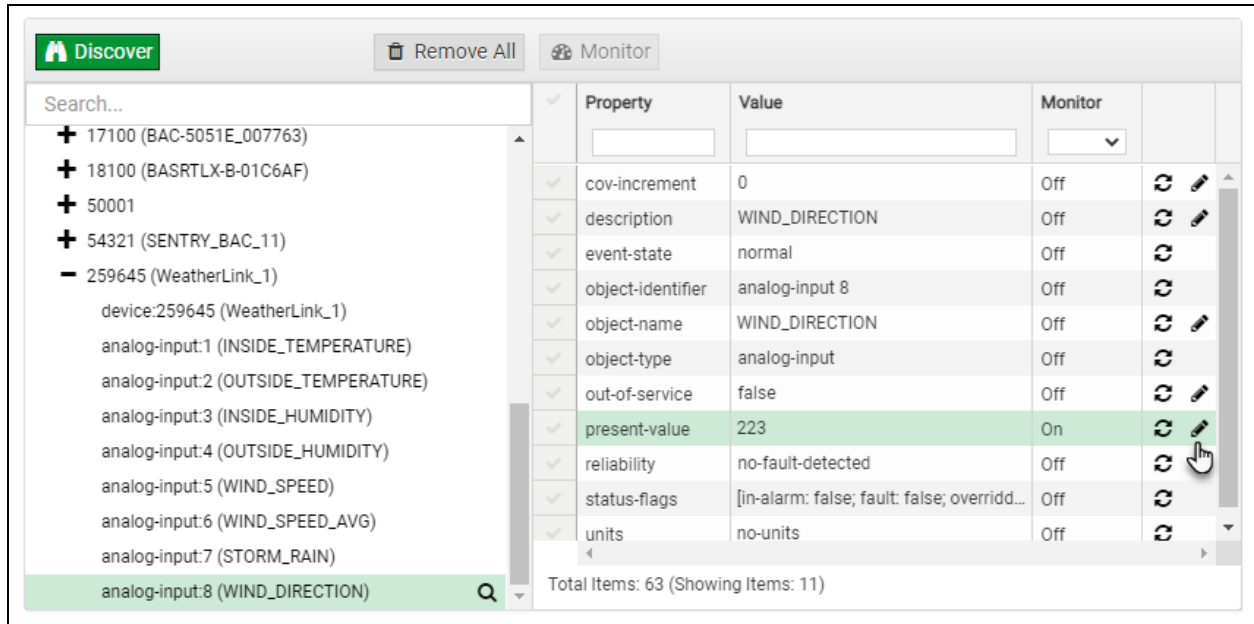

Property	Value	Monitor	
cov-increment	0	Off	🔄 ✎
description	WIND_DIRECTION	Off	🔄 ✎
event-state	normal	Off	🔄 ✎
object-identifier	analog-input 8	Off	🔄 ✎
object-name	WIND_DIRECTION	Off	🔄 ✎
object-type	analog-input	Off	🔄 ✎
out-of-service	false	Off	🔄 ✎
present-value	223	On	🔄 ✎
reliability	no-fault-detected	Off	🔄 ✎
status-flags	[in-alarm: false; fault: false; overrid...	Off	🔄 ✎
units	no-units	Off	🔄 ✎

- Then click the Write button (✎) on the right of the property to bring up the Write Property window.

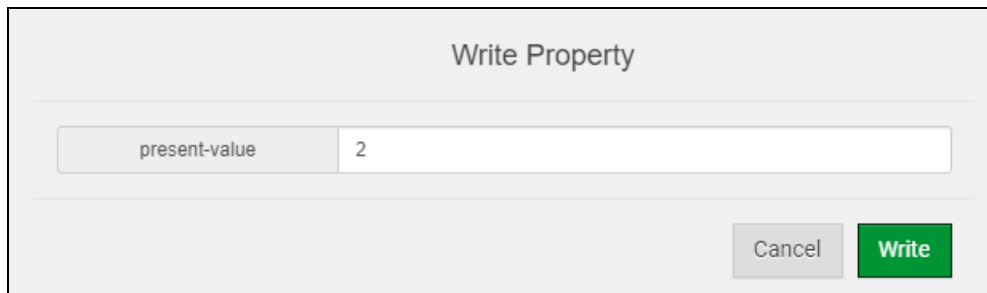

Write Property

present-value 2

Cancel Write

- Enter the appropriate change and click the Write button.

The window will close. When the BACnet Explorer page appears, the present value will be changed as specified.

The screenshot shows the BACnet Explorer interface. On the left is a tree view of discovered devices. The selected device is 'analog-input:8 (WIND_DIRECTION)'. The main area displays a table of properties for this device.

Property	Value	Monitor	
cov-increment	0	Off	Refresh Edit
description	WIND_DIRECTION	Off	Refresh Edit
event-state	normal	Off	Refresh
object-identifier	analog-input 8	Off	Refresh
object-name	WIND_DIRECTION	Off	Refresh Edit
object-type	analog-input	Off	Refresh
out-of-service	false	Off	Refresh Edit
present-value	2	On	Refresh Edit
reliability	no-fault-detected	Off	Refresh
status-flags	[in-alarm: false; fault: false; overridd...	Off	Refresh
units	no-units	Off	Refresh

At the bottom of the interface, it says 'Total Items: 63 (Showing Items: 11)'.


10 MSA Grid - FieldServer Manager Setup

The MSA Grid is MSA Safety's device cloud solution for IIoT. Integration with the MSA Grid - FieldServer Manager enables the a secure remote connection to field devices through a FieldServer and hosts local applications for device configuration, management, as well as maintenance. For more information about the FieldServer Manager, refer to the [MSA Grid - FieldServer Manager Start-up Guide](#).

10.1 Create a New FieldServer Manager Account

The first step to connecting to the FieldServer Manager is to create an account.

- Click on the FieldServer Manager tab.

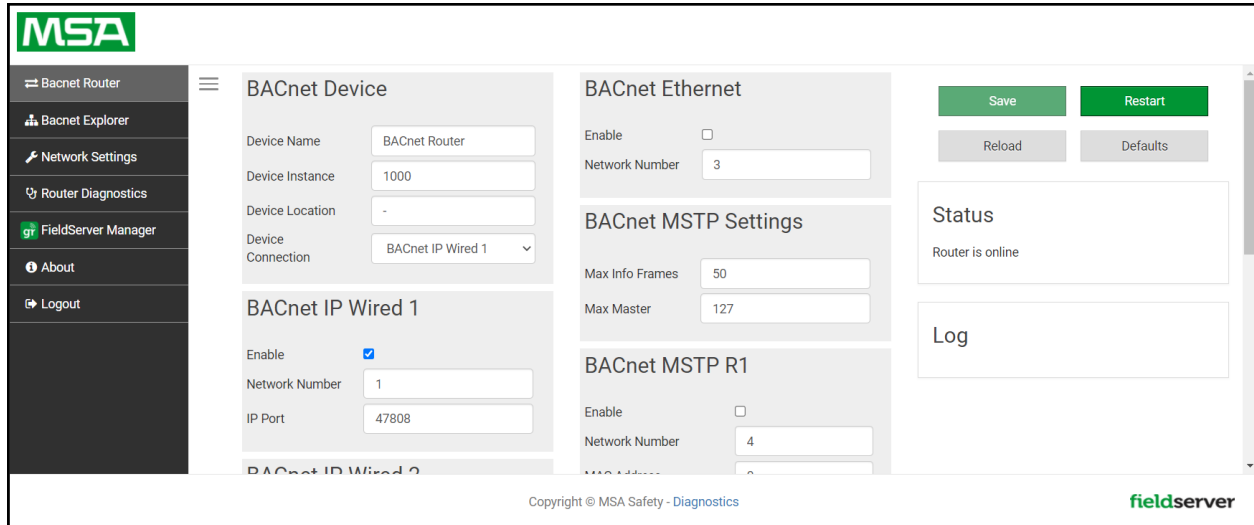

- An informational splash page will appear, click the Close button to view the registration page.


Grid FieldServer Manager Registration

Securely access your FieldServer from anywhere with the **Grid FieldServer Manager**

Your one stop for managing your FieldServers and users

- ✓ **Secure Remote Access**
Securely connect your field devices to Grid FieldServer Manager.
- ✓ **FieldServer Management**
Manage all your FieldServers and connected devices from Grid FieldServer Manager and upgrade firmware remotely.
- ✓ **User Management**
Set up your user personnel with the right security permissions and FieldServer assignments for users to diagnose, configure, and better support the field installation.

For more information about Grid FieldServer Manager, visit [our website](#).

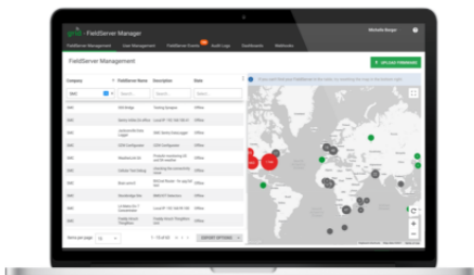

[Get Started](#)

- If a warning message appears instead of the splash page, follow the suggestion that appears on screen.
- If the BACnet Router cannot reach the FieldServer Manager server, the following message will appear.

Grid FieldServer Manager Registration

Grid FieldServer Manager™ Server Unreachable

The device is unable to connect to the Grid FieldServer Manager server.

The following network issues have been detected. Correcting them might resolve connectivity to the server:

- Could not ping Gateway [192.168.2.1]
- Could not ping Domain Name Server 1 [8.8.8.8]
- Could not ping Domain Name Server 2 [8.8.4.4]

Ensure your network firewall is configured to allow this device to access the Grid FieldServer Manager server:

- Error Code: **EAL_AGAIN**
- FieldServer MAC address: **00:50:4E:60:6C:E8**
- Allow HTTPS communications to the following domains on **port 443**:
 - **www.fieldpop.io**
 - **ts.fieldpop.io**

- Follow the directions presented in the warning message and check that the DNS settings are set up with the following Domain Name Server (DNS) settings:
DNS1=8.8.8.8
DNS2=8.8.4.4
- Ensure that the BACnet Router is properly connected to the Internet

NOTE: If changes to the network settings are done, remember to save and then power cycle the BACnet Router to update the settings.

- Fill in the user details, site details, gateway details and create a new account.
 - Enter user details and click Next

The screenshot shows the 'Installer Details' step, which is the first of four steps in the registration process. The steps are: 1. Installer Details, 2. Installation Site, 3. FieldServer Details, and 4. Account Details. The 'Installer Details' section includes the following fields:

- Installer Name:
- Company:
- Telephone:
- Email:
- Installation Date:

At the bottom right, there are two buttons: a grey 'Cancel' button and a green 'Next' button.

- Enter the site details by entering the physical address fields or the latitude and longitude then click Next

The screenshot shows the 'Installation Site Details' step, which is the second of four steps in the registration process. The steps are: 1. Installer Details, 2. Installation Site, 3. FieldServer Details, and 4. Account Details. The 'Installation Site Details' section includes the following fields:

- Search:
- Site Name:
- Building:
- Street Address:
- Suburb:
- City:
- State:
- Country:
- Postal Code:
- Latitude:
- Longitude:

On the right side of the form, there is a Google Maps interface with 'Map' and 'Satellite' tabs. The map shows a location in the Lafayette, Louisiana area. At the bottom right, there are three buttons: a grey 'Cancel' button, a grey 'Previous' button, and a green 'Next' button.

- Enter Name and Description (required) then click Next

Grid FieldServer Manager Registration

Progress: 1 Installer Details, 2 Installation Site, **3 FieldServer Details**, 4 Account Details

FieldServer Details

Name

Description

FieldServer Info
Optionally specify any other information relating to the FieldServer i.e., calibration, commissioning or other notes

Timezone (GMT -08:00) America/Los_Angeles

Buttons: Cancel, Previous, **Next**

- Click the “Create an Grid FieldServer Manager account” button and enter a valid email to send a “Welcome to FieldServer Manager” invite to the email address entered

Grid FieldServer Manager Registration

Progress: 1 Installer Details, 2 Installation Site, 3 FieldServer Details, **4 Account Details**

New Users

If you do not have Grid FieldServer Manager credentials, you can create a new Grid FieldServer Manager account now [Create an Grid FieldServer Manager account](#)

Existing Users - Enter FieldServer registration details

User Credentials

Username

Password

Buttons: Cancel, Previous, **Register FieldServer**

- Once the device has successfully been registered, a confirmation window will appear. Click the Close button and the following screen will appear listing the device details and additional information auto-populated by the BACnet Router.

Grid FieldServer Manager Registration


FieldServer Registered

FieldServer Details Name: Test1 Description: FS Test FieldServer Info: Timezone: America/Los_Angeles MAC Address: 00:50:4E:60:13:FE Tunnel Server URL: tunnel.fieldpop.io FieldServer ID: treedancer_KrgPKmLRY Product Name: Core Application - Default Product Version: 5.2.0	Installer Details Installer Name: Test Company: MSA Safety Telephone: (408) 444-4444 Email: contactus@msasafety.com Installation Date: Sep 20, 2021	Installation Site Details Site Name: Site#1 Building: Street Address: 1020 Canal Road Suburb: City: Lafayette State: Indiana Country: United States Postal Code: 47904
---	--	---

[Update FieldServer Details](#)

NOTE: Update these details at any time by going to the FieldServer Manager tab and clicking the Update FieldServer Details button.

- Open the registered email account.
- The “Welcome to FieldServer Manager” email will appear as shown below.

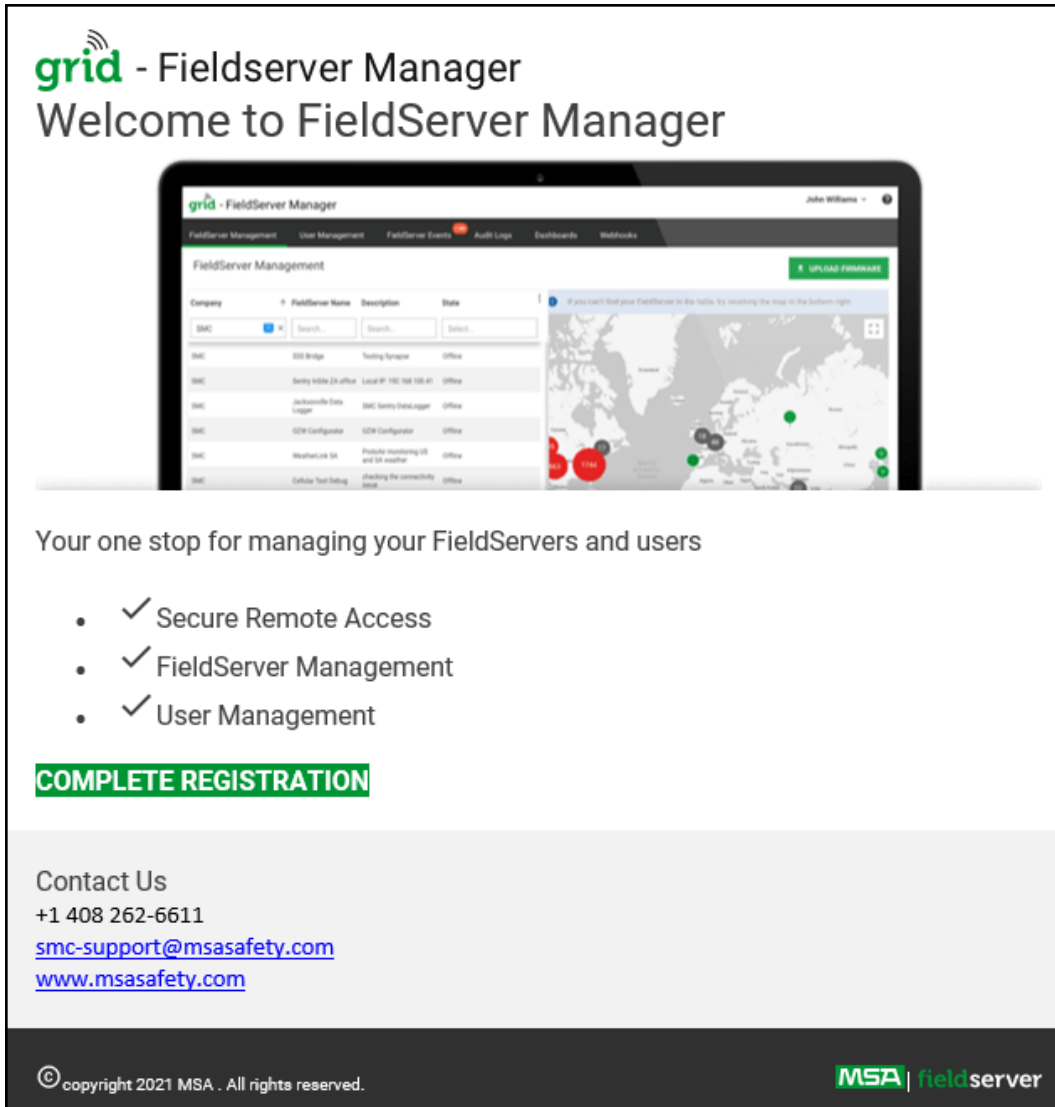

NOTE: If no email was received, check the spam/junk folder for an email from notification@fieldpop.io. Contact the FieldServer support team if the email cannot be found.

- Click the “Complete Registration” button and fill in user details accordingly.

Complete Your Registration

Email Address

First Name
 *

Last Name
 *

Mobile Phone Number
 *
*Invalid Mobile Number

New Password
 *
* Please enter new password

Confirm Password
 *

By registering my account with MSA, I understand that I am agreeing to the FieldServer Manager [Terms of Service and Privacy Policy](#) *

* Mandatory Fields


- Fill in the name, phone number, password fields and click the checkbox to agree to the privacy policy and terms of service.

NOTE: If access to data logs using RESTful API is needed, do not include “#” in the password.

- Click “Save” to save the user details.
- Click “OK” when the Success message appears.
- Record the email account used and password for future use.

10.2 Login to the FieldServer Manager

After the gateway is registered, go to www.smccloud.net and type in the appropriate login information as per registration credentials.

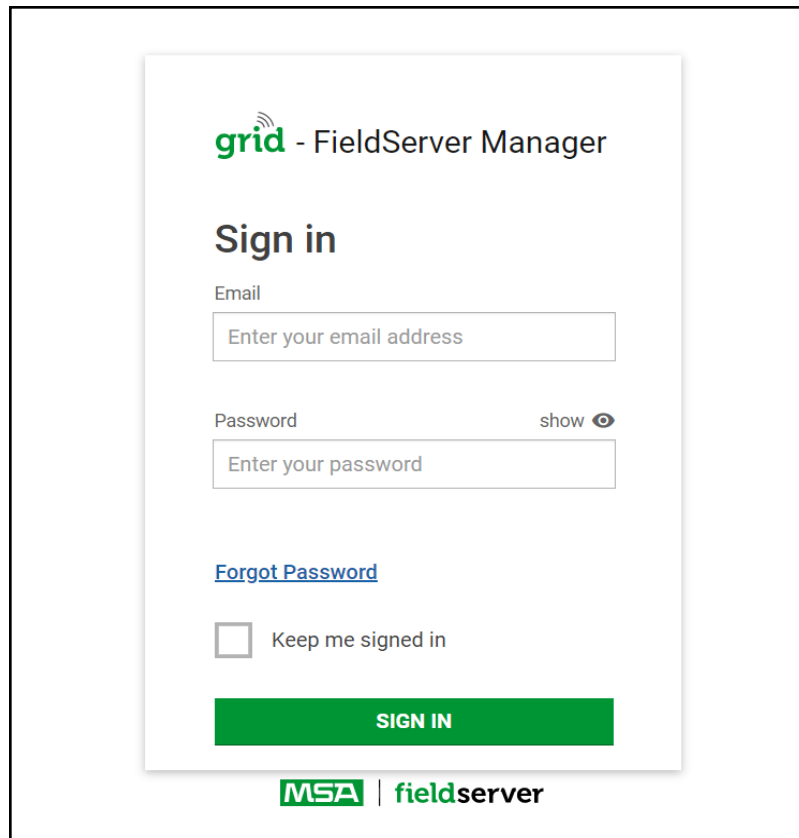

The screenshot shows the login interface for the FieldServer Manager. At the top, the logo 'grid' is displayed in green, followed by the text '- FieldServer Manager'. Below this is the heading 'Sign in'. There are two input fields: one for 'Email' with the placeholder text 'Enter your email address', and one for 'Password' with the placeholder text 'Enter your password'. To the right of the password field is a 'show' button with an eye icon. Below the password field is a blue link for 'Forgot Password'. There is a checkbox labeled 'Keep me signed in'. At the bottom of the form is a green button labeled 'SIGN IN'. At the very bottom of the page, the logos for 'MSA' and 'fieldserver' are displayed.

NOTE: If the login password is lost, see the [MSA Grid - FieldServer Manager Start-up Guide](#) for recovery instructions.

NOTE: For additional FieldServer Manager instructions see the [MSA Grid - FieldServer Manager Start-up Guide](#).

FieldServer Management

[↑ UPLOAD FIRMWARE](#)

Company	FieldServer Name	Description	State
Eggers OEM	Jens's Brain 31	192.168.1.31	Offline
Eggers OEM	Jens MBP Core App	~/git/smc-core-application	Offline
Eggers OEM	Jens's Dell Profile View	~/git/profile-view	Offline
Eggers OEM	hd_test_log_to_fpop	testing_modbus	Offline
Eggers OEM	Mbus demo	testing registration	Offline
SMC	TestWall-PA2port 97	Testwall pa 2 97	Offline
SMC	TestWall-Lon152	Testwall unit	Offline


If you can't find your FieldServer in the table, try resetting the map in the bottom right.

© 2021 MSA. All rights reserved. **MSA** | fieldserver

11 Troubleshooting

11.1 Tooltips

Tooltips appear when the mouse pointer hovers over the corresponding settings field. A balloon will appear giving a description of that input field. This applies to all input fields.

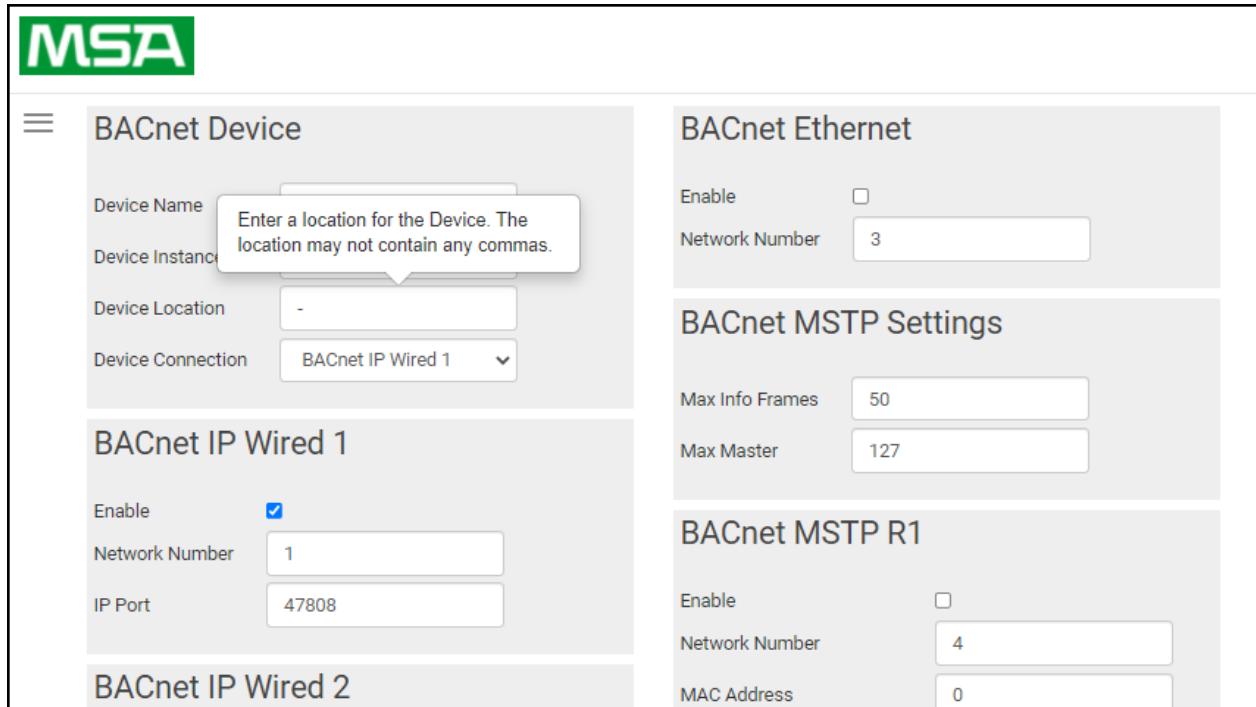


The screenshot displays the MSA web interface for configuring BACnet settings. The interface is organized into several panels:


- BACnet Device:** Contains fields for Device Name, Device Instance, Device Location (with a tooltip), and Device Connection (set to BACnet IP Wired 1).
- BACnet IP Wired 1:** Contains fields for Enable (checked), Network Number (1), and IP Port (47808).
- BACnet IP Wired 2:** A header for a second BACnet IP Wired configuration.
- BACnet Ethernet:** Contains fields for Enable (unchecked) and Network Number (3).
- BACnet MSTP Settings:** Contains fields for Max Info Frames (50) and Max Master (127).
- BACnet MSTP R1:** Contains fields for Enable (unchecked), Network Number (4), and MAC Address (0).

A tooltip is visible over the Device Location field, containing the text: "Enter a location for the Device. The location may not contain any commas."


11.2 Taking a FieldServer Diagnostic Capture

When there is a problem on-site that cannot easily be resolved, perform a Diagnostic Capture before contacting support. Once the Diagnostic Capture is complete, email it to technical support. The Diagnostic Capture will accelerate diagnosis of the problem.

- Access the FieldServer Diagnostics page via one of the following methods:
 - Open the FieldServer FS-GUI page and click on Diagnostics in the Navigation panel
 - Open the FieldServer Toolbox software and click the diagnose icon  of the desired device

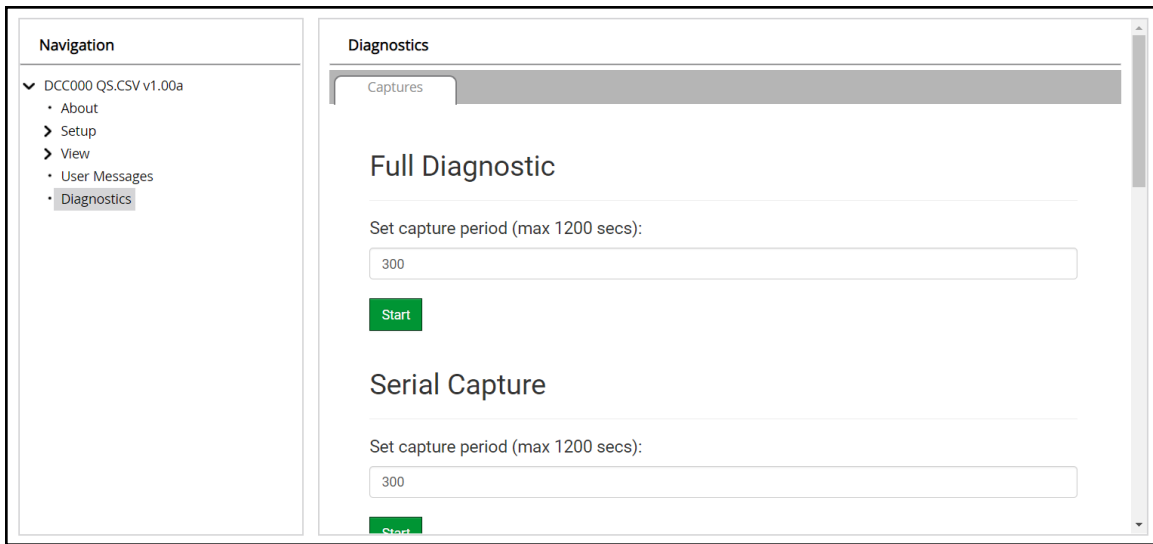

- Go to Full Diagnostic and select the capture period.
- Click the Start button under the Full Diagnostic heading to start the capture.
 - When the capture period is finished, a Download button will appear next to the Start button

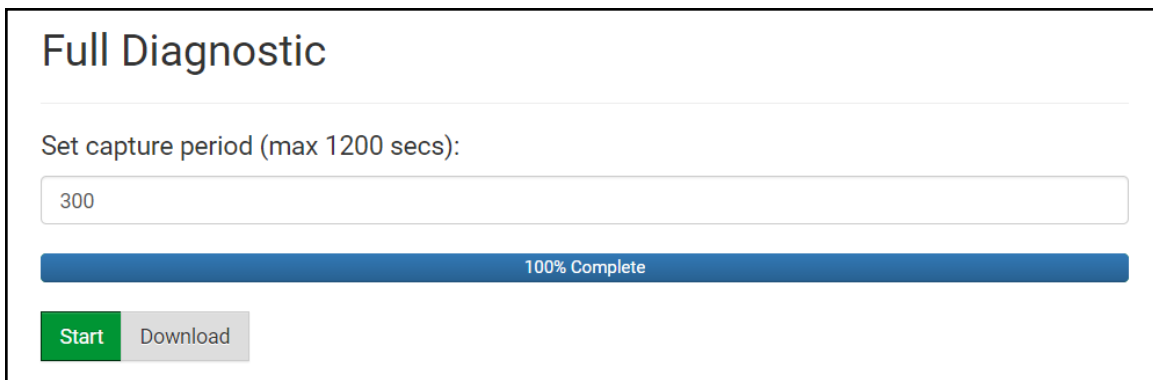

- Click Download for the capture to be downloaded to the local PC.
- Email the diagnostic zip file to technical support (smc-support.emea@msasafety.com).

NOTE: Diagnostic captures of BACnet MS/TP communication are output in a “.PCAP” file extension which is compatible with Wireshark.

11.3 Factory Reset Instructions

For instructions on how to reset a FieldServer back to its factory released state, see [ENOTE FieldServer Next Gen Recovery](#).

11.4 Internet Browser Software Support

The following web browsers are supported:

- Chrome Rev. 57 and higher
- Firefox Rev. 35 and higher
- Microsoft Edge Rev. 41 and higher
- Safari Rev. 3 and higher

NOTE: Internet Explorer is no longer supported as recommended by Microsoft.

NOTE: Computer and network firewalls must be opened for Port 80 to allow FieldServer GUI to function.

11.5 Wi-Fi Signal Strength

Wi-Fi
<60dBm – Excellent
<70dBm – Very good
<80dBm – Good
>80dBm – Weak


NOTE: If the signal is weak or spotty, try to improve the signal strength by checking the antenna and the FieldServer position.

12 Additional Information


12.1 Change Web Server Security Settings After Initial Setup

NOTE: Any changes will require a FieldServer reboot to take effect.

- Navigate from the BACnet Router landing page to the FS-GUI by clicking the blue “Diagnostics” text on the bottom of the screen.

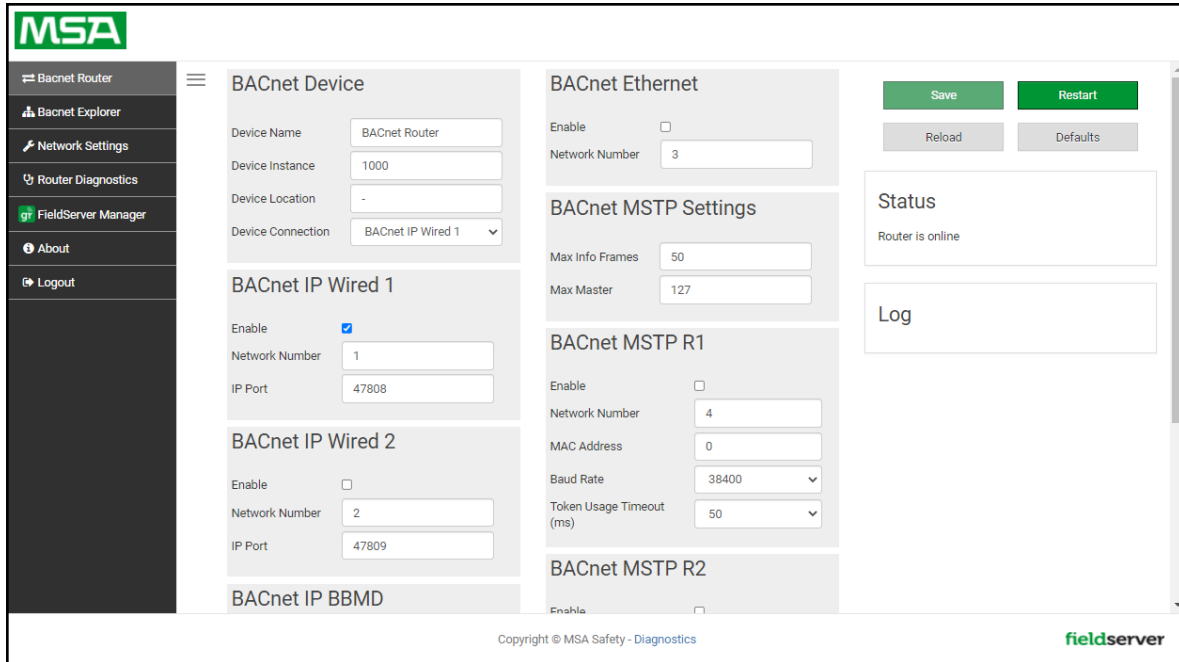


- Click Setup in the Navigation panel.

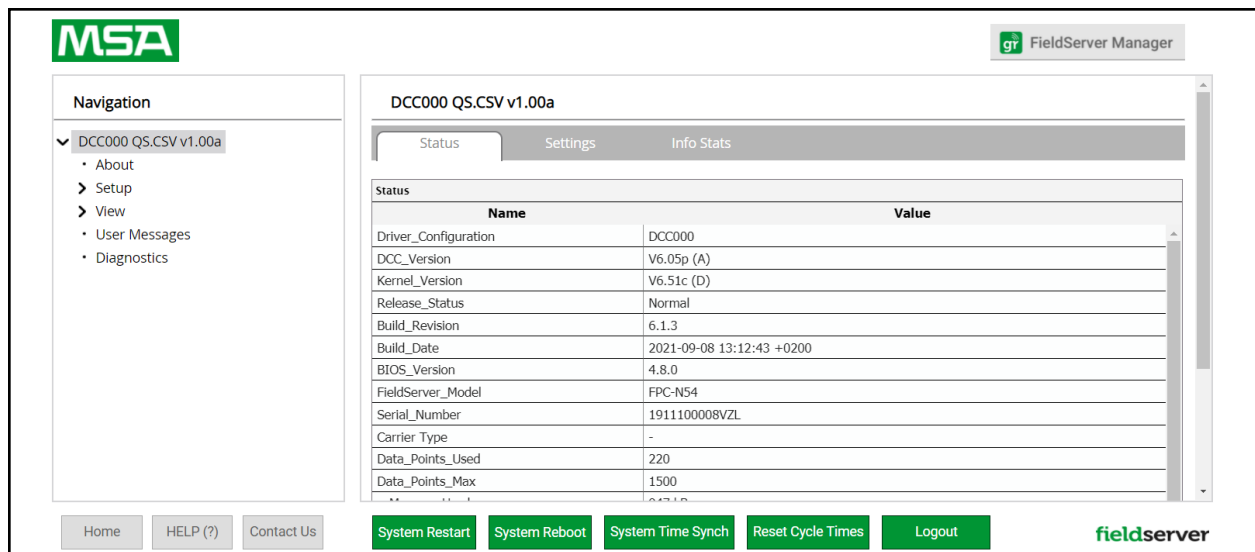

12.1.1 Change Security Mode

- Click Security in the Navigation panel.

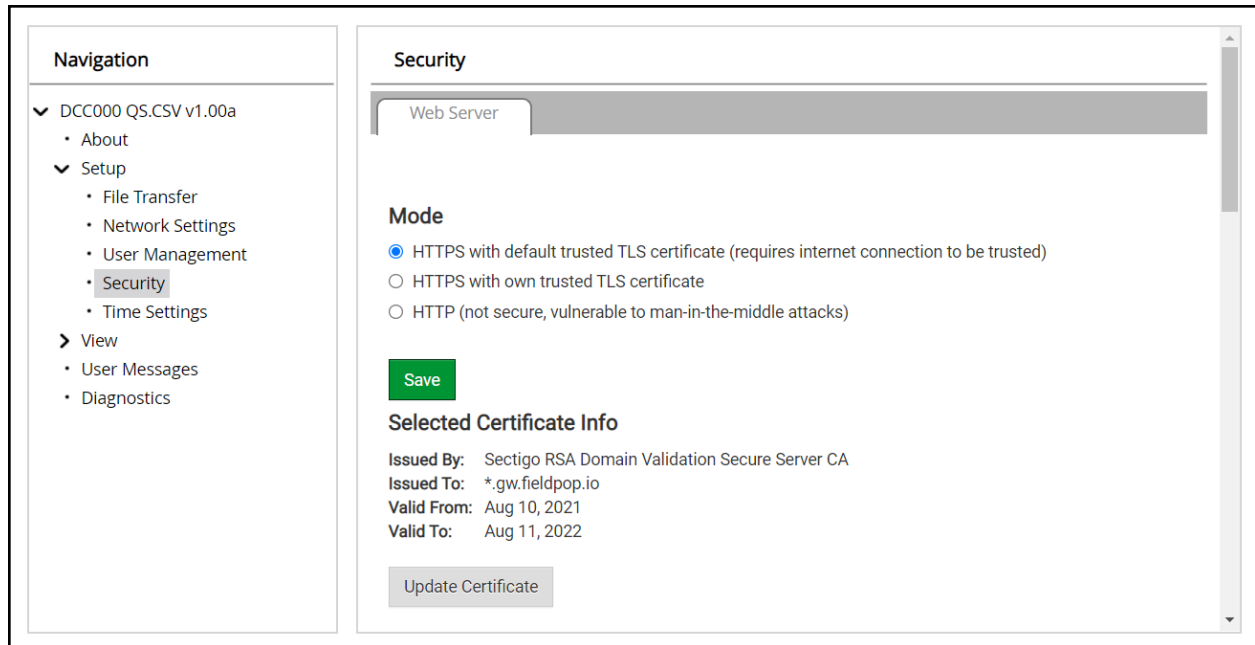


- Click the Mode desired.
 - If HTTPS with own trusted TLS certificate is selected, follow instructions in [Section 6.2.1 HTTPS with Own Trusted TLS Certificate](#)
- Click the Save button.

12.1.2 Edit the Certificate Loaded onto the FieldServer

NOTE: A loaded certificate will only be available if the security mode was previously setup as HTTPS with own trusted TLS certificate.

- Click Security in the Navigation panel.

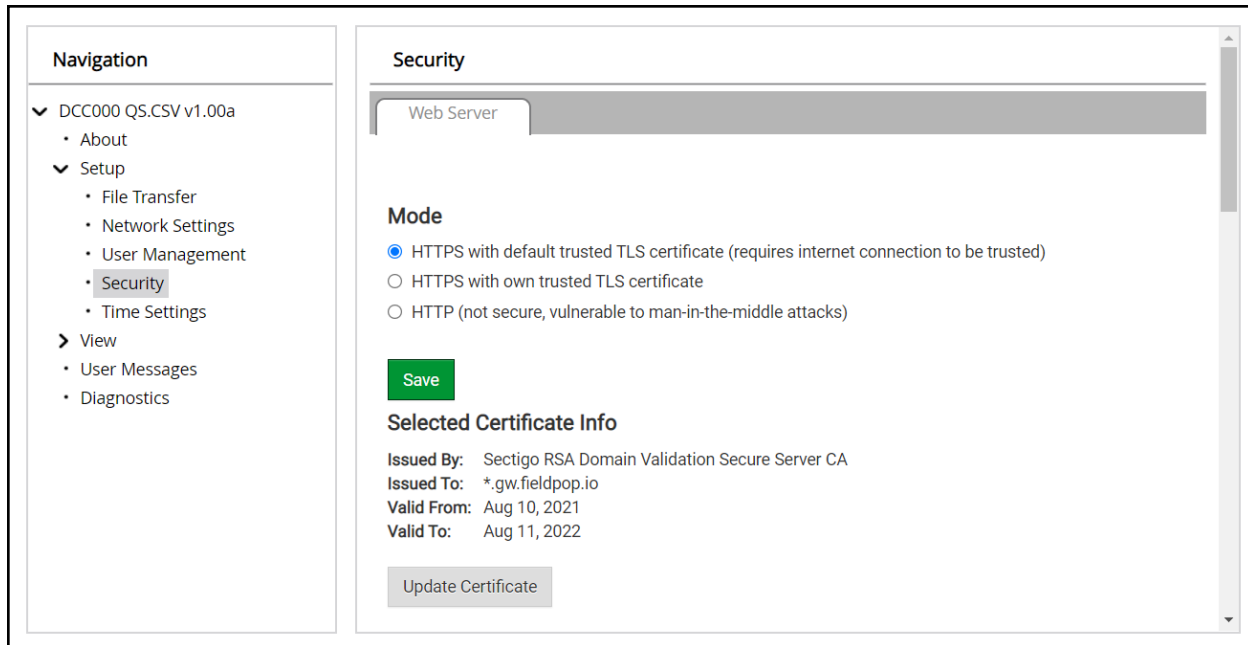

- Click the Edit Certificate button to open the certificate and key fields.
- Edit the loaded certificate or key text as needed.
- Click Save.


12.2 Change User Management Settings

- From the FS-GUI page, click Setup in the Navigation panel.
- Click User Management in the navigation panel.

NOTE: If the passwords are lost, the unit can be reset to factory settings to reinstate the default unique password on the label. For recovery instructions, see the . If the default unique password is lost, then the unit must be mailed back to the factory.

NOTE: Any changes will require a FieldServer reboot to take effect.

- Check that the Users tab is selected.

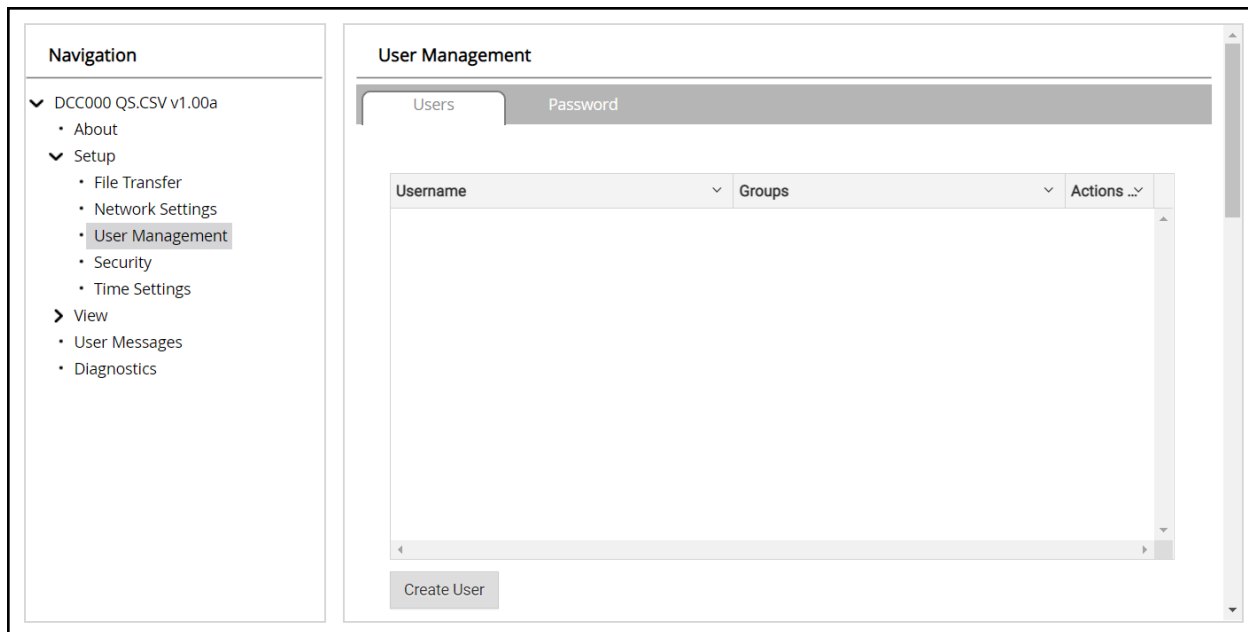

User Types:

Admin – Can modify and view any settings on the FieldServer.

Operator – Can modify and view any data in the FieldServer array(s).

Viewer – Can only view settings/readings on the FieldServer.

12.2.1 Create Users

- Click the Create User button.

Create User

Username:
Enter a unique username

Security Groups:

- Admin
- Operator
- Viewer

Password: Weak
Enter password

Show Passwords

Confirm Password:
Confirm password

Generate Password

Create Cancel


- Enter the new User fields: Name, Security Group and Password.
 - **User details are hashed and salted**

NOTE: The password must meet the minimum complexity requirements. An algorithm automatically checks the password entered and notes the level of strength on the top right of the Password text field.

- Click the Create button.
- Once the Success message appears, click OK.

12.2.2 Edit Users

- Click the pencil icon next to the desired user to open the User Edit window.

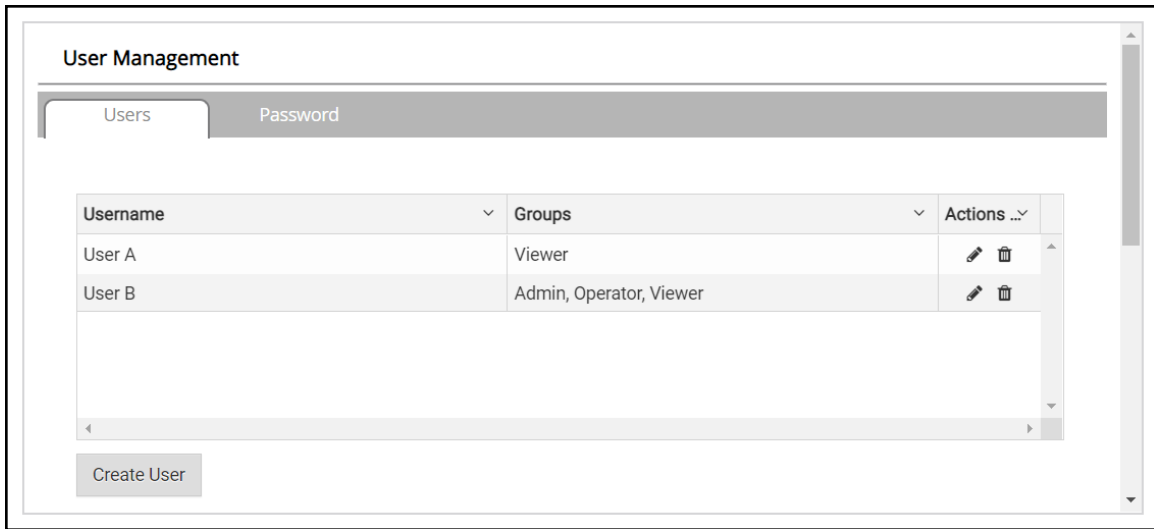

- Once the User Edit window opens, change the User Security Group and Password as needed.


The 'Edit User' dialog box contains the following fields and options:

- Username:** A text input field containing 'User A'.
- Security Groups:** Three checkboxes: 'Admin' (unchecked), 'Operator' (unchecked), and 'Viewer' (checked).
- Password:** A text input field containing 'Optional'.
- Show passwords
- Confirm Password:** A text input field containing 'Optional'.
-
- (highlighted in green)
-


- Click Confirm.
- Once the Success message appears, click OK.

12.2.3 Delete Users

- Click the trash can icon next to the desired user to delete the entry.

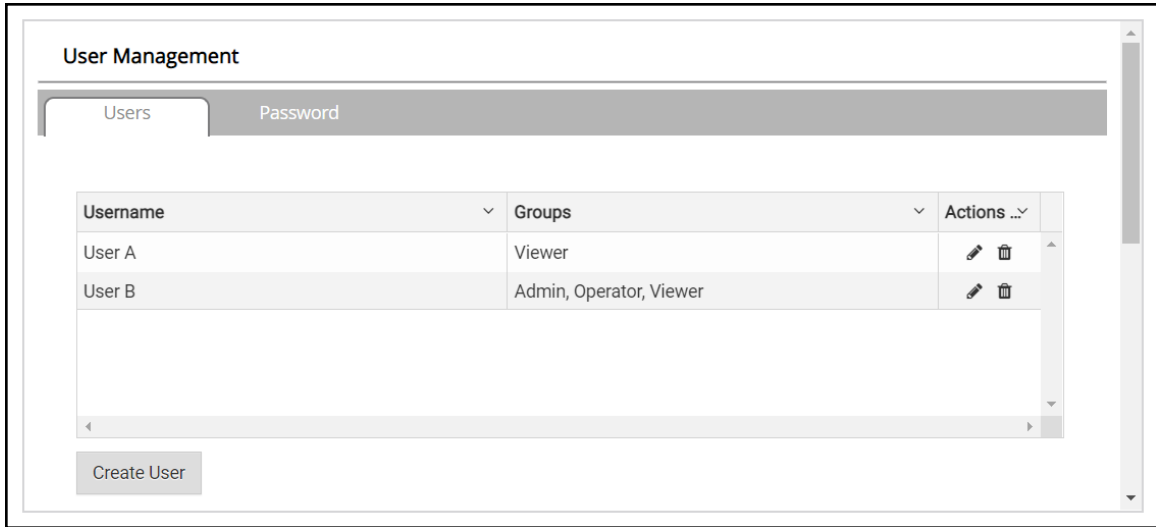


- When the warning message appears, click Confirm.

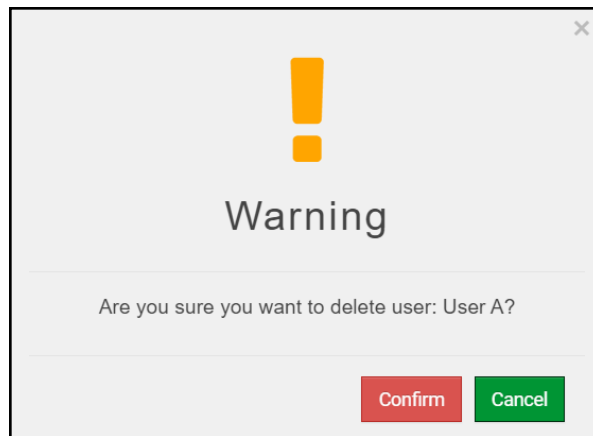

12.2.4 Change FieldServer Password

- Click the Password tab.

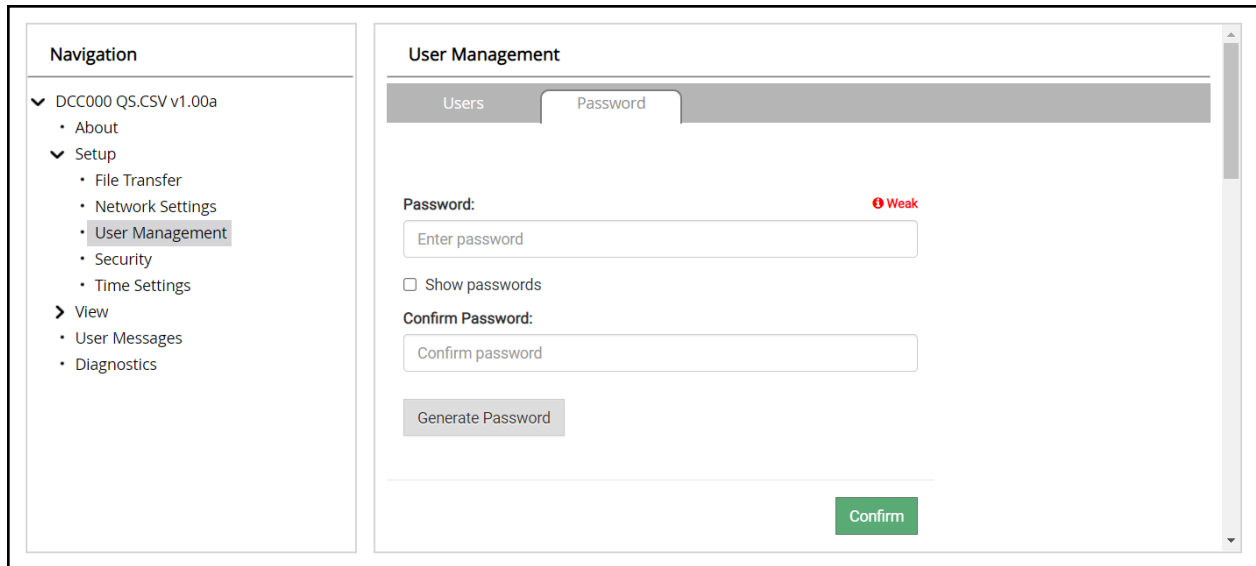

The screenshot shows a web interface for 'User Management' with two tabs: 'Users' and 'Password'. The 'Password' tab is active. On the left is a 'Navigation' sidebar with a tree structure: 'DCC000 QS.CSV v1.00a' (expanded) containing 'About', 'Setup' (expanded) containing 'File Transfer', 'Network Settings', 'User Management' (highlighted), 'Security', and 'Time Settings', and 'View' containing 'User Messages' and 'Diagnostics'. The main content area has a 'Password:' label with a red 'Weak' indicator and a text input field containing 'Enter password'. Below it is a 'Show passwords' checkbox. A 'Confirm Password:' label is followed by a text input field containing 'Confirm password'. A 'Generate Password' button is located below the input fields. At the bottom right of the main area is a green 'Confirm' button.

- Change the general login password for the FieldServer as needed.

NOTE: The password must meet the minimum complexity requirements. An algorithm automatically checks the password entered and notes the level of strength on the top right of the Password text field.

12.3 Specifications



FS-ROUTER-BACW					
Electrical Connections	One 3-pin Phoenix connector with: RS-485/RS-232 (Tx+ / Rx- / gnd) One 3-pin Phoenix connector with: RS-485 (+ / - / gnd) One 3-pin Phoenix connector with: Power port (+ / - / Frame-gnd) One Ethernet 10/100 BaseT port				
Power Requirements	<table style="width: 100%; border: none;"> <tr> <td style="border: none;"><i>Input Voltage:</i> 9-30VDC or 24VAC</td> <td style="border: none;"><i>Current draw:</i> 24VAC 0.125A</td> </tr> <tr> <td style="border: none;"><i>Max Power:</i> 3 Watts</td> <td style="border: none;">9-30VDC 0.25A @12VDC</td> </tr> </table>	<i>Input Voltage:</i> 9-30VDC or 24VAC	<i>Current draw:</i> 24VAC 0.125A	<i>Max Power:</i> 3 Watts	9-30VDC 0.25A @12VDC
<i>Input Voltage:</i> 9-30VDC or 24VAC	<i>Current draw:</i> 24VAC 0.125A				
<i>Max Power:</i> 3 Watts	9-30VDC 0.25A @12VDC				
Approvals	CE and FCC Part 15, UL 60950-1 and CAN/CSA C22.2, WEEE compliant, RoHS compliant, DNP 3.0 and Modbus conformance tested, REACH compliant, UKCA compliant				
Physical Dimensions	4 x 1.1 x 2.7 in (10.16 x 2.8 x 6.8 cm)				
Weight	0.4 lbs (0.2 Kg)				
Operating Temperature	-20°C to 70°C (-4°F to 158°F)				
Humidity	10-95% RH non-condensing				
Wi-Fi 802.11 b/g/n	<table style="width: 100%; border: none;"> <tr> <td style="border: none;"><i>Frequency:</i> 2.4 GHz</td> <td style="border: none;"><i>Channels:</i> 1 to 11 (inclusive)</td> </tr> <tr> <td style="border: none;"><i>Antenna:</i> Omnidirectional SMA</td> <td style="border: none;"><i>Encryption:</i> TKIP, WPA2 & AES</td> </tr> </table>	<i>Frequency:</i> 2.4 GHz	<i>Channels:</i> 1 to 11 (inclusive)	<i>Antenna:</i> Omnidirectional SMA	<i>Encryption:</i> TKIP, WPA2 & AES
<i>Frequency:</i> 2.4 GHz	<i>Channels:</i> 1 to 11 (inclusive)				
<i>Antenna:</i> Omnidirectional SMA	<i>Encryption:</i> TKIP, WPA2 & AES				

NOTE: Specifications subject to change without notice.

12.4 Warnings for FCC and IC

Waste Disposal

It is recommended to disassemble the device before abandoning it in conformity with local regulations. Please ensure that the abandoned batteries are disposed according to local regulations on waste disposal. Do not throw batteries into fire (explosive) or put in common waste canister. Products or product packages with the sign of “explosive” should not be disposed like household waste but delivered to specialized electrical & electronic waste recycling/disposal center. Proper disposal of this sort of waste helps avoiding harm and adverse effect upon surroundings and people’s health. Please contact local organizations or recycling/disposal center for more recycling/disposal methods of related products.

Comply with the following safety tips:

Do Not use in Combustible and Explosive Environment

Keep away from combustible and explosive environment for fear of danger.

Keep away from all energized circuits.

Operators should not remove enclosure from the device. Only the group or person with factory certification is permitted to open the enclosure to adjust and replace the structure and components of the device. Do not change components unless the power cord is removed. In some cases, the device may still have residual voltage even if the power cord is removed. Therefore, it is a must to remove and fully discharge the device before contact so as to avoid injury.

Unauthorized Changes to this Product or its Components are Prohibited

In the aim of avoiding accidents as far as possible, it is not allowed to replace the system or change components unless with permission and certification. Please contact the technical department of Vantron or local branches for help.

Pay Attention to Caution Signs

Caution signs in this manual remind of possible danger. Please comply with relevant safety tips below each sign. Meanwhile, you should strictly conform to all safety tips for operation environment.

Notice

Considering that reasonable efforts have been made to assure accuracy of this manual, Vantron assumes no responsibility of possible missing contents and information, errors in contents, citations, examples, and source programs.

Vantron reserves the right to make necessary changes to this manual without prior notice. No part of this manual may be reprinted or publicly released.

FCC Warning

This device complies with FCC class B Rules. Operation is subject to the Following conditions.

This device may not cause harmful interference.

This device must accept any interference received, including interference that may cause undesired operation.

NOTE: This equipment has been tested and found to comply with the limits for a Class B digital device, pursuant to part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference in a residential installation. This equipment generates, uses and can radiate radio frequency energy and, if not installed and used in accordance with the instructions, may cause harmful interference to radio communications. However, there is no guarantee that interference will not occur in a particular installation. If this equipment does cause harmful interference to radio or television reception, which can be determined by turning the equipment off and on, the user is encouraged to try to correct the interference by one or more of the following measures:

- Reorient or relocate the receiving antenna.
- Connect the equipment into an outlet on a circuit different from that to which the receiver is connected.
- Consult the dealer or an experienced radio/TV technician for help.

Any modification to the product is not permitted unless authorized by MSA Safety. It's not allowed to disassemble the product; it is not allowed to replace the system or change components unless with permission and certification. Please contact the FieldServer technical support department or local branches for help.

IC Statement

This device complies with Industry Canada license-exempt RSS standard(s). Operation is subject to the following two conditions:

- This device may not cause interference, and
- This device must accept any interference, including interference that may cause undesired operation of the device.

Warning! This class B digital apparatus complies with Canadian ICES-003.

Industry Canada ICES-003 Compliance Label:

CAN ICES-3 (B)/NMB-3(B)

Le présent appareil est conforme aux CNR d'Industrie Canada applicables aux appareils radio exempts.

L'exploitation est autorisée aux deux conditions suivantes:

- l'appareil ne doit pas produire de brouillage, et
- l'utilisateur de l'appareil doit accepter tout brouillage radioélectrique subi, même si le brouillage est susceptible d'en compromettre le fonctionnement.

RF Exposure Warning

This equipment must be installed and operated in accordance with provide instructions and the antenna used for this transmitter must be installed to provide a separation distance of at least 20 cm from all persons and must not be co-located or operation in conjunction with any other antenna or transmitter. End-users and installers must be provided with antenna installation instructions and transmitter operating conditions for satisfying RF exposure compliance.

For product compliance test FCC and IC, all the technical documentation is submitted by MSA Safety, who is the customer or importer of the product BACnet Router.

Power Output

Frequency Range Output Power:

Wi-Fi

2402.0 – 2480 MHz 0.004 W

2412.0 – 2462.0 MHz 0.0258 W

The Output Power listed is conducted. The device should be professionally installed to ensure compliance with power requirements. The antenna(s) used for this transmitter must be installed to provide a separation distance of at least 20 cm from all persons and not be co-located with any other transmitters except in accordance with multi-transmitter product procedures. This device supports 20MHz and 40MHz bandwidth.

13 Limited 2 Year Warranty

MSA Safety warrants its products to be free from defects in workmanship or material under normal use and service for two years after date of shipment. MSA Safety will repair or replace any equipment found to be defective during the warranty period. Final determination of the nature and responsibility for defective or damaged equipment will be made by MSA Safety personnel.

All warranties hereunder are contingent upon proper use in the application for which the product was intended and do not cover products which have been modified or repaired without MSA Safety's approval or which have been subjected to accident, improper maintenance, installation or application; or on which original identification marks have been removed or altered. This Limited Warranty also will not apply to interconnecting cables or wires, consumables or to any damage resulting from battery leakage.

In all cases MSA Safety's responsibility and liability under this warranty shall be limited to the cost of the equipment. The purchaser must obtain shipping instructions for the prepaid return of any item under this warranty provision and compliance with such instruction shall be a condition of this warranty.

Except for the express warranty stated above, MSA Safety disclaims all warranties with regard to the products sold hereunder including all implied warranties of merchantability and fitness and the express warranties stated herein are in lieu of all obligations or liabilities on the part of MSA Safety for damages including, but not limited to, consequential damages arising out of/or in connection with the use or performance of the product.